




# PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS




RECLAIMED WATER



SEWER




POTABLE WATER



FIRE LINE

## TYPICAL VALVE BOX COVER DETAILS

NOTE: COVERS AND RINGS TO TRAFFIC RATED PER FDOT STANDARDS AND SPECIFICATIONS.

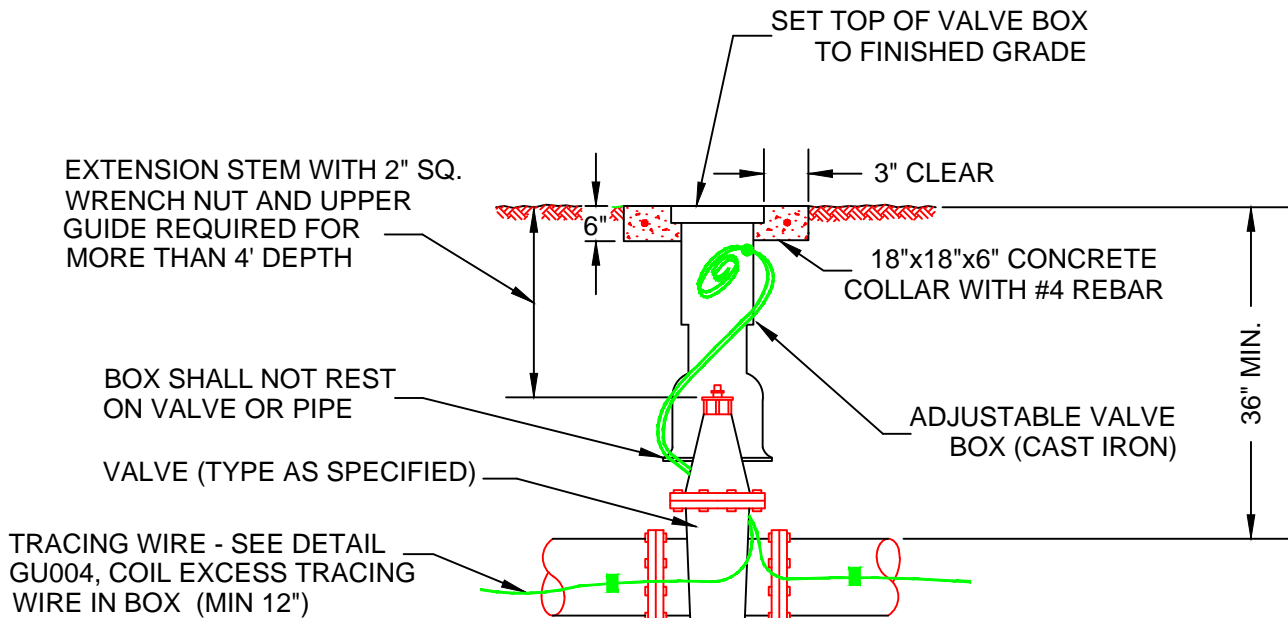

## TYPICAL VALVE AND VALVE BOX DETAIL

ADDITIONAL REFERENCE: FIRE HYDRANT DETAIL PW002-4.



CITY OF ALTAMONTE SPRINGS  
950 CALABRIA DRIVE  
ALTAMONTE SPRINGS, FLORIDA 32714

## VALVE, VALVE BOX & COVER

**GU005-3**

ISSUED 2017

REVISED 03/01/2017 BY DJB