



# PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

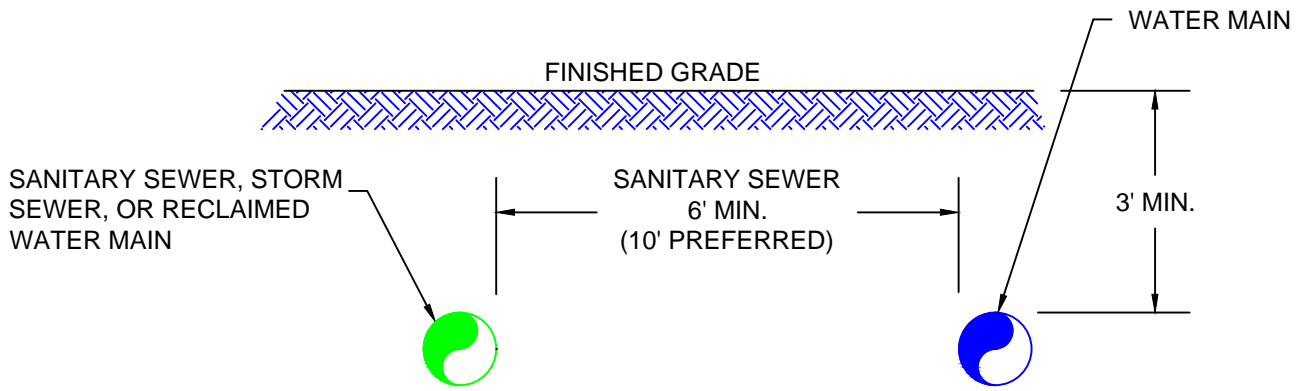

**NOTES: (HORIZONTAL)**

1. A MINIMUM SEPARATION OF SIX (6) FEET, OUTSIDE TO OUTSIDE, SHALL BE MAINTAINED BETWEEN WATER MAINS AND SANITARY SEWER, GRAVITY- OR PRESSURE-TYPE SANITARY SEWER, OR WASTEWATER FORCE MAIN.
2. A MINIMUM HORIZONTAL SEPARATION OF THREE (3) FEET, OUTSIDE TO OUTSIDE, SHALL BE MAINTAINED BETWEEN WATER MAINS AND RECLAIMED WATER LINES CARRYING UNRESTRICTED PUBLIC ACCESS REUSE WATER, AND STORM SEWER LINES.

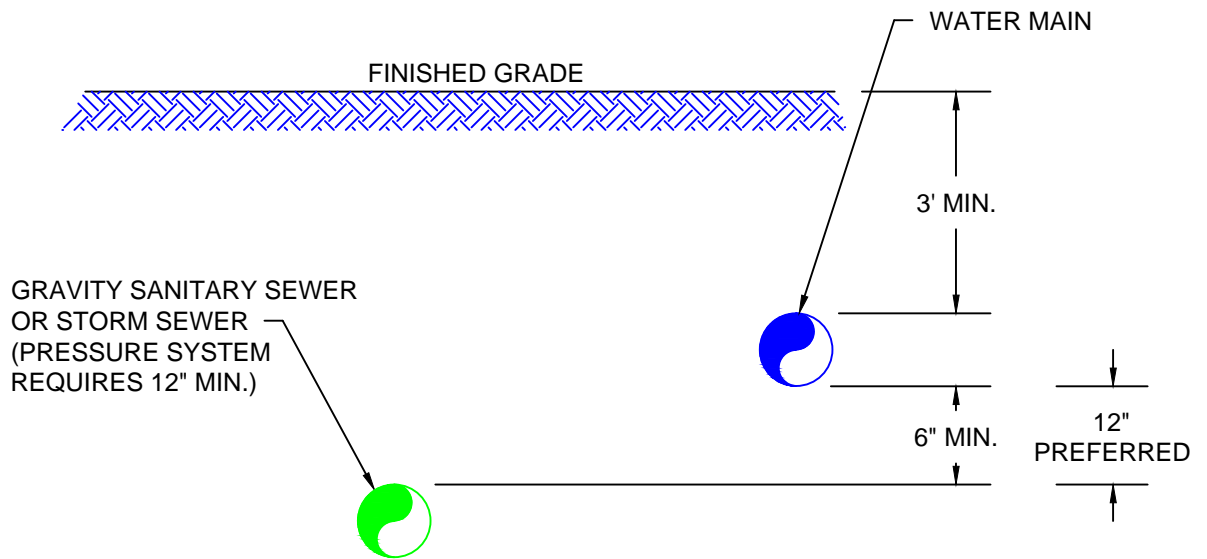

3. THE MINIMUM HORIZONTAL SEPARATION DISTANCE BETWEEN WATER MAINS AND SANITARY GRAVITY SEWERS SHALL BE REDUCED TO THREE FEET (3') WHERE THE BOTTOM OF THE WATER MAIN IS LAID AT LEAST SIX INCHES (6") ABOVE THE TOP OF THE SEWER (62-555.314(C)).



CITY OF ALTAMONTE SPRINGS  
950 CALABRIA DRIVE  
ALTAMONTE SPRINGS, FLORIDA 32714

## UTILITY PIPE MIN. SEPARATION REQUIREMENTS

**GU007-2A**

ISSUED 2017

REVISED 03/01/2017 BY DJB