



PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

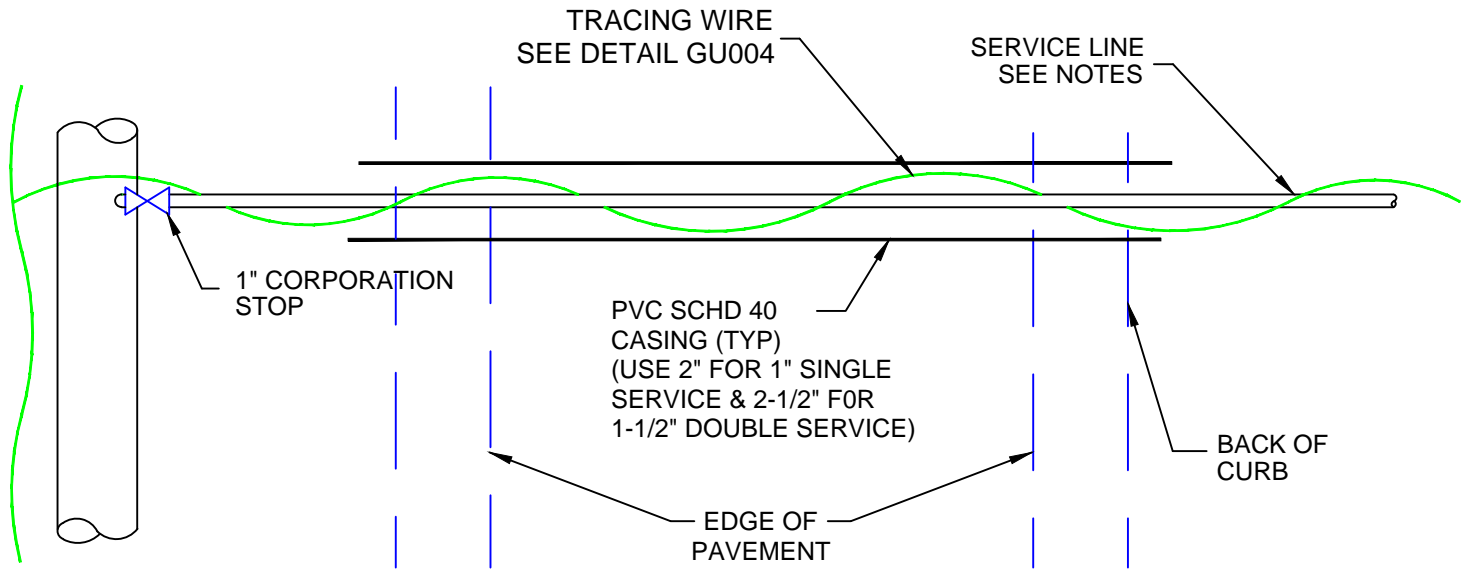

PLAN

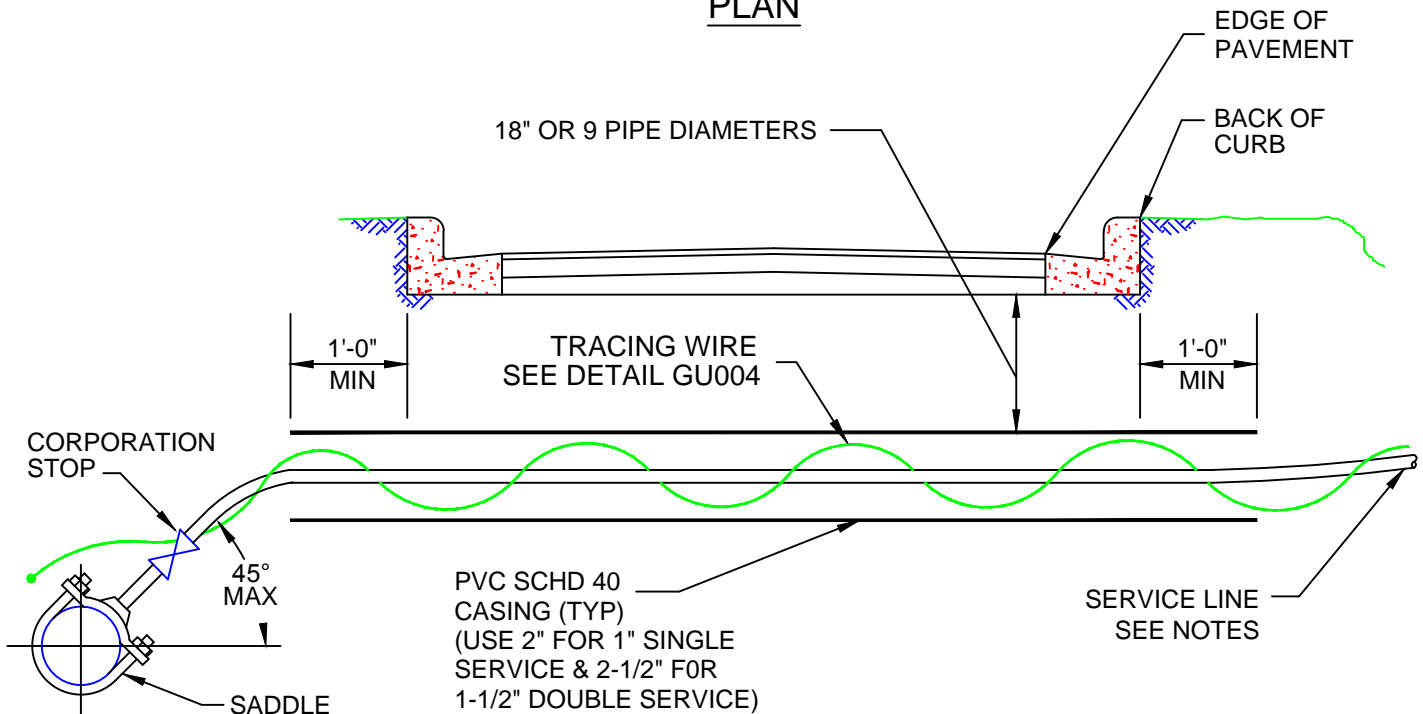

SECTION

NOTES:

SERVICE LINE CONTINUATION SEE DETAIL:

1. RW002 - RECLAIMED WATER SINGLE SERVICE CONNECTION.
2. PW004 - POTABLE WATER SINGLE SERVICE CONNECTION.
3. PW005 - POTABLE WATER DOUBLE SERVICE CONNECTION.



CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

BORE AND JACK FOR WATER SERVICE CONNECTION

GU008-2

ISSUED 2017

REVISED 03/01/2017 BY DJB