


PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

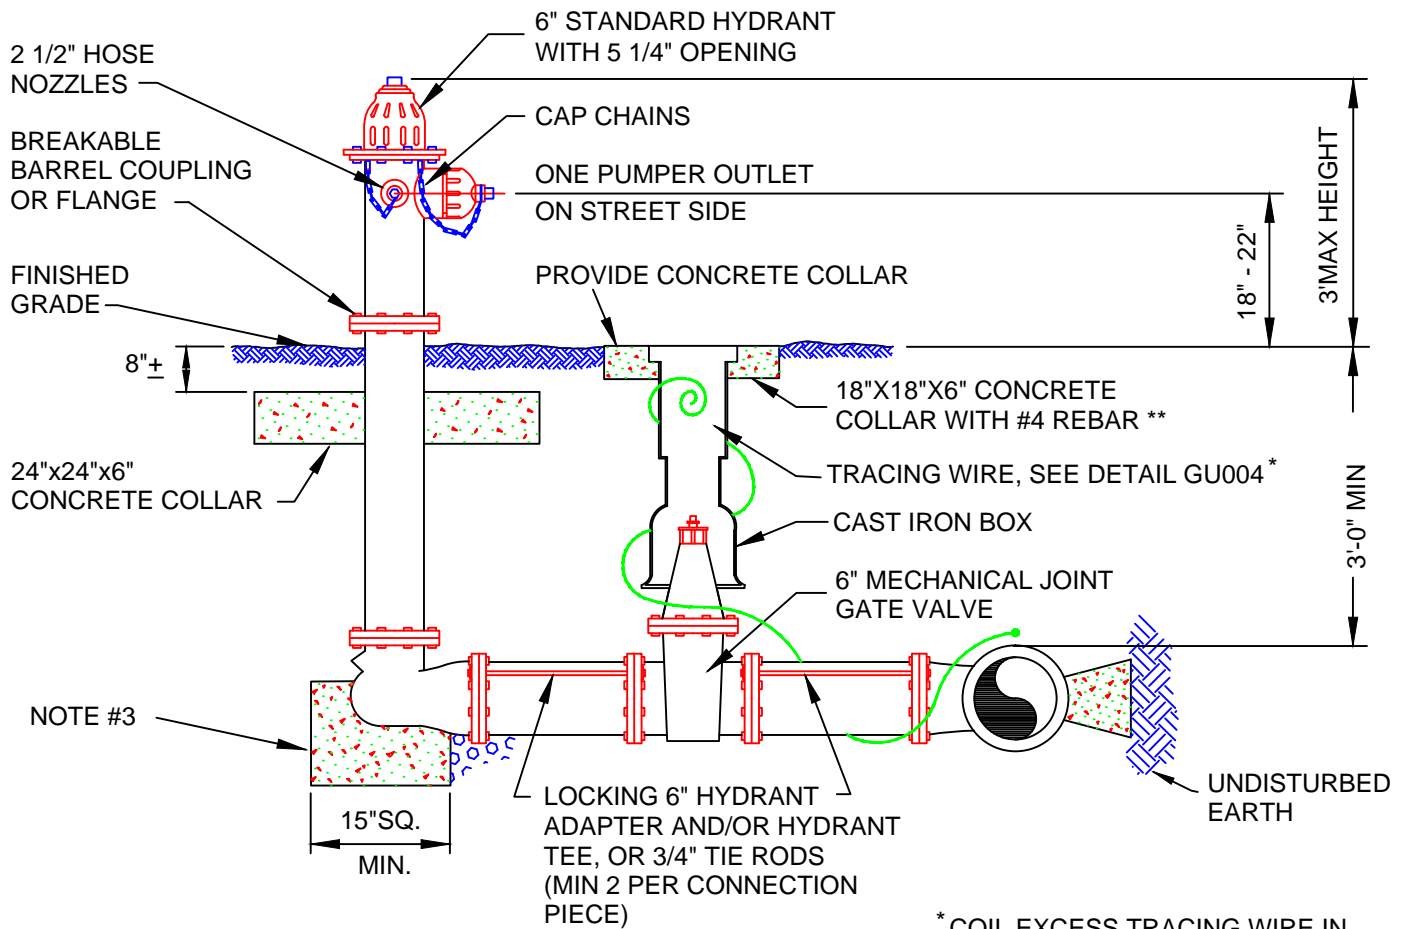

* COIL EXCESS TRACING WIRE IN BOX. (MIN 12")

** A 16" DIAMETER X 6" THICK CIRCULAR COLLAR MAY BE SUBSTITUTED FOR THE 18"X18"X6" COLLAR.

NOTES:

1. THE HYDRANTS ACCEPTABLE TO THE CITY OF ALTAMONTE SPRINGS, SHALL BE EITHER THE KENNEDY K81A, AMERICAN DARLING B84B, OR THE MUELLER A-423.
2. CONCRETE COLLAR AROUND LOWER BARREL OF HYDRANT IN SANDY SOIL OR HYDRANTS CONNECTED TO P.V.C. MAINS.
3. HYDRANT BASE AND TEE MUST BE WRAPPED IN 4 MIL POLYETHYLENE. NO CONCRETE WILL EXTEND ABOVE MID LINE OF PIPE
4. WEEP HOLES TO BE PLUGGED.
5. A VERTICAL CLEARANCE SHALL BE MAINTAINED FOR A HORIZONTAL DISTANCE OF 5 FEET IN ALL DIRECTIONS AROUND ALL HYDRANTS.
6. PRIVATELY-OWNED WATER SYSTEM HYDRANTS SHALL BE MAINTAINED BY OWNERS.



CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

STANDARD FIRE HYDRANT ASSEMBLY

PW002-4

ISSUED 2017

REVISED 03/01/2017 BY DJB