



PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

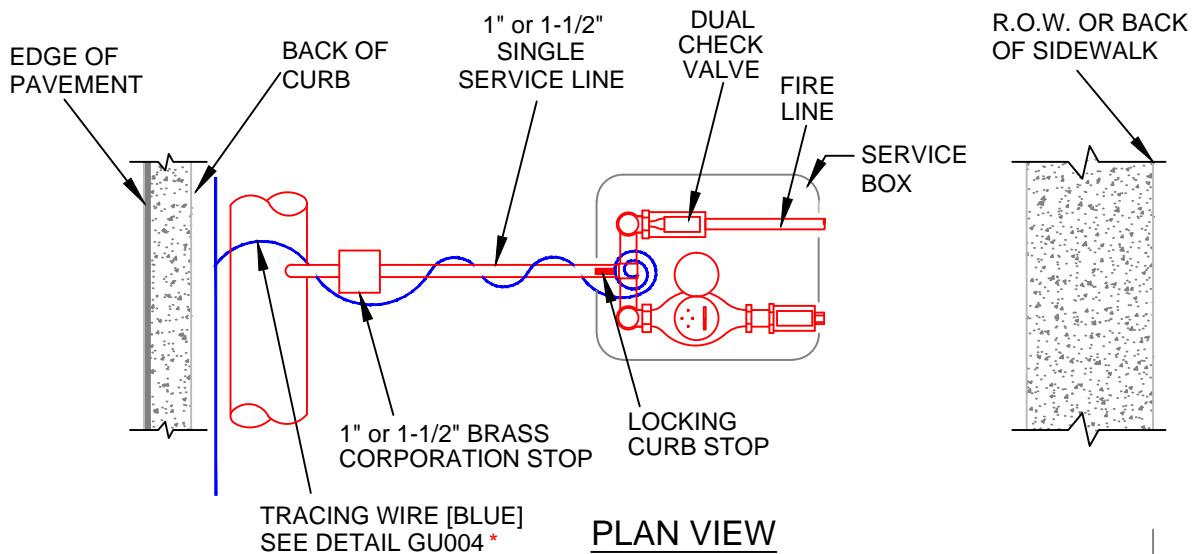

PLAN VIEW

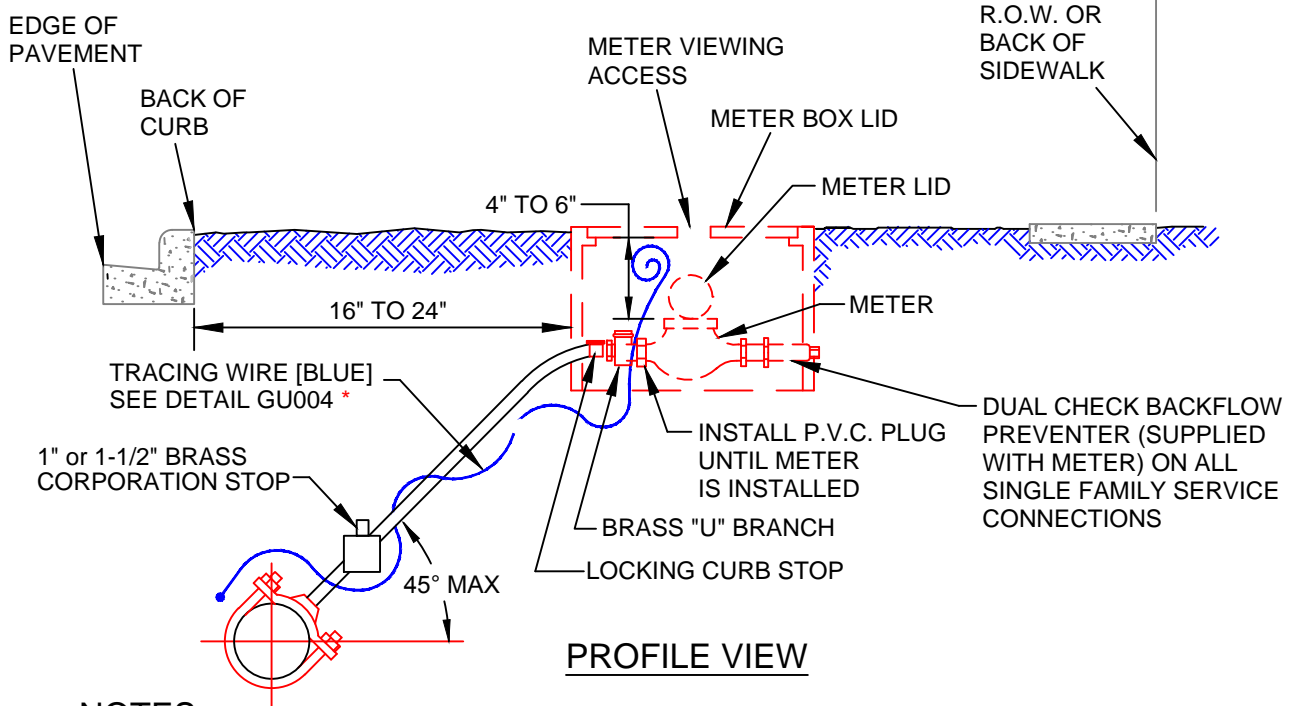

PROFILE VIEW

NOTES:

1. SERVICE BOX FURNISHED BY CITY OF ALTAMONTE SPRINGS.
2. METER SHALL BE INSTALLED BETWEEN SIDEWALK AND CURB AND IN NO CASE SHALL IT BE INSTALLED IN THE SIDEWALK OR OTHER PAVED AREAS.
3. THE CITY WILL SUPPLY AND INSTALL THE DUAL CHECK VALVES, METER, "U", AND CURB STOP. CONTRACTOR TO SPECIFY SIZING OF FIRE SPRINKLER DUAL CHECK VALVE AND "U" AT 3/4" OR 1".
4. THE CUSTOMER WILL BE REQUIRED TO PAY FOR CURB STOP, "U" BRANCH AND DUAL CHECK VALVES EXCEEDING 1".
5. THE FIRE SPRINKLER DESIGNER MUST CONTACT THE PUBLIC WORKS DEPARTMENT AT 407-571-8533 TO OBTAIN MANUFACTURE SPECIFICATIONS FOR THE DUAL CHECK VALVE TO INCLUDE THIS LOSS IN THE FIRE SPRINKLER SYSTEM HYDRAULIC CALCULATIONS.

* COIL EXCESS TRACING WIRE IN BOX



CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

POTABLE WATER - ONE & TWO-FAMILY COMBINATION FIRE SERVICE

PW004-1B

ISSUED 2017

REVISED 03/01/2017 BY DJB