
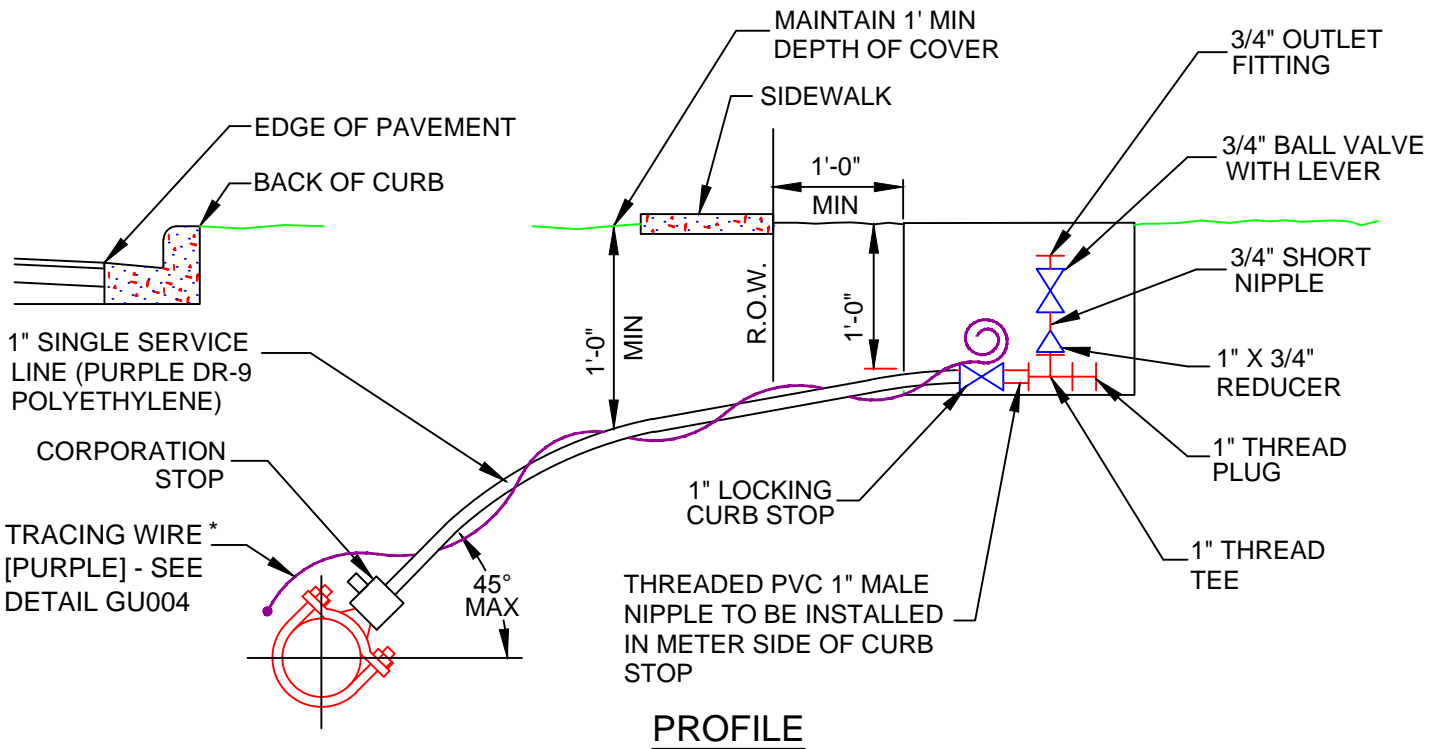


# PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

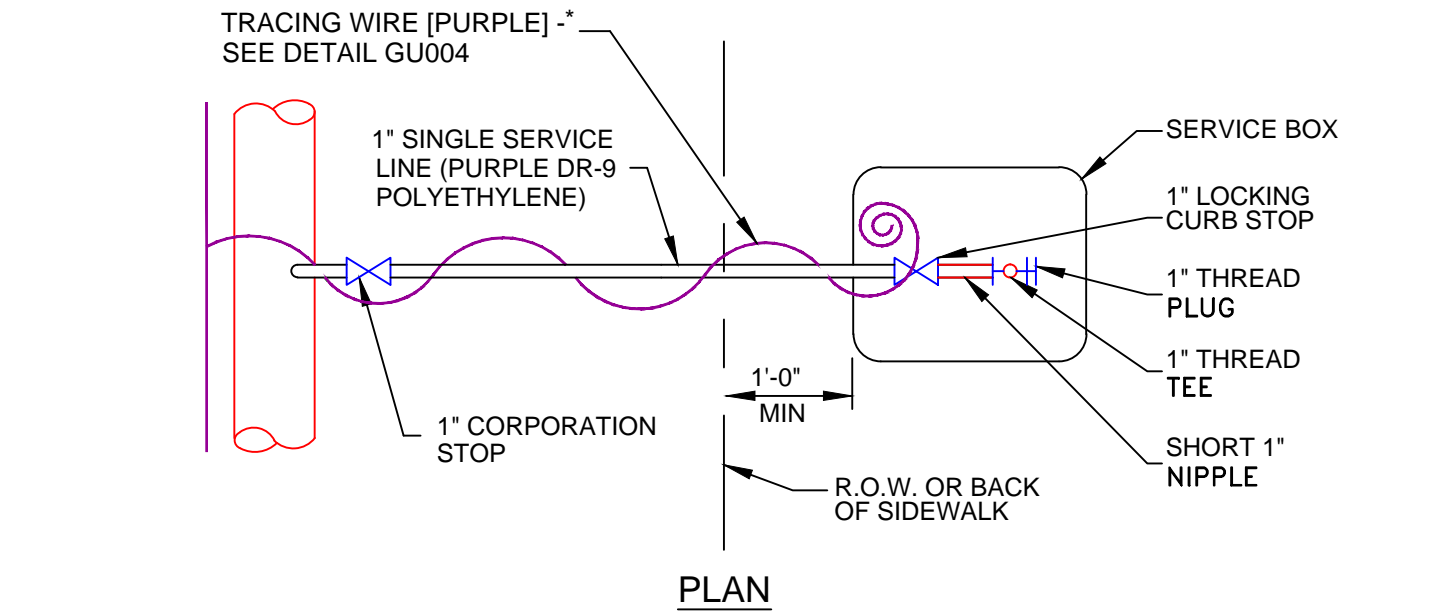

## NOTES:

1. SERVICE BOX FURNISHED BY THE CITY OF ALTAMONTE SPRINGS
2. ALL PVC FITTINGS TO BE SCHEDULE 80.
3. 3" MIN BETWEEN TEE AND 3/4" BALL VALVE IN VALVE BOX.

\* COIL EXCESS TRACING WIRE IN BOX (MIN. 12")



CITY OF ALTAMONTE SPRINGS  
950 CALABRIA DRIVE  
ALTAMONTE SPRINGS, FLORIDA 32714

## RECLAIMED WATER - SINGLE SERVICE CONNECTION

**RW002-2**

ISSUED 2017

REVISED 03/01/2017 BY DJB