



PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

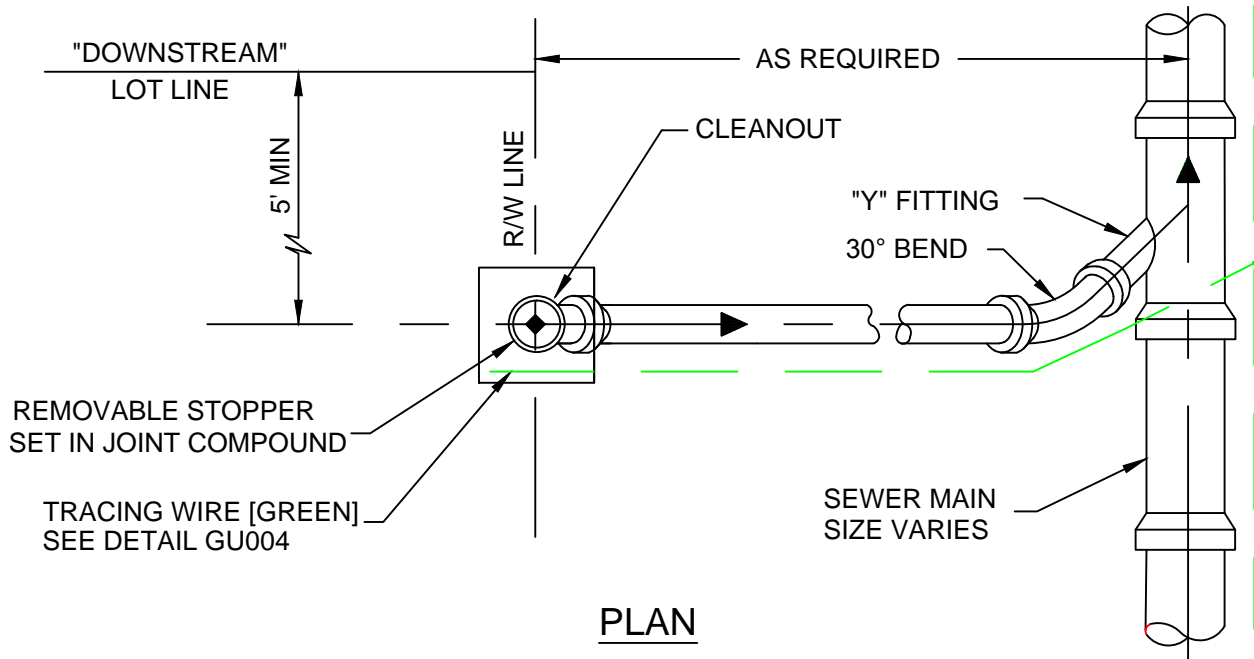

PLAN

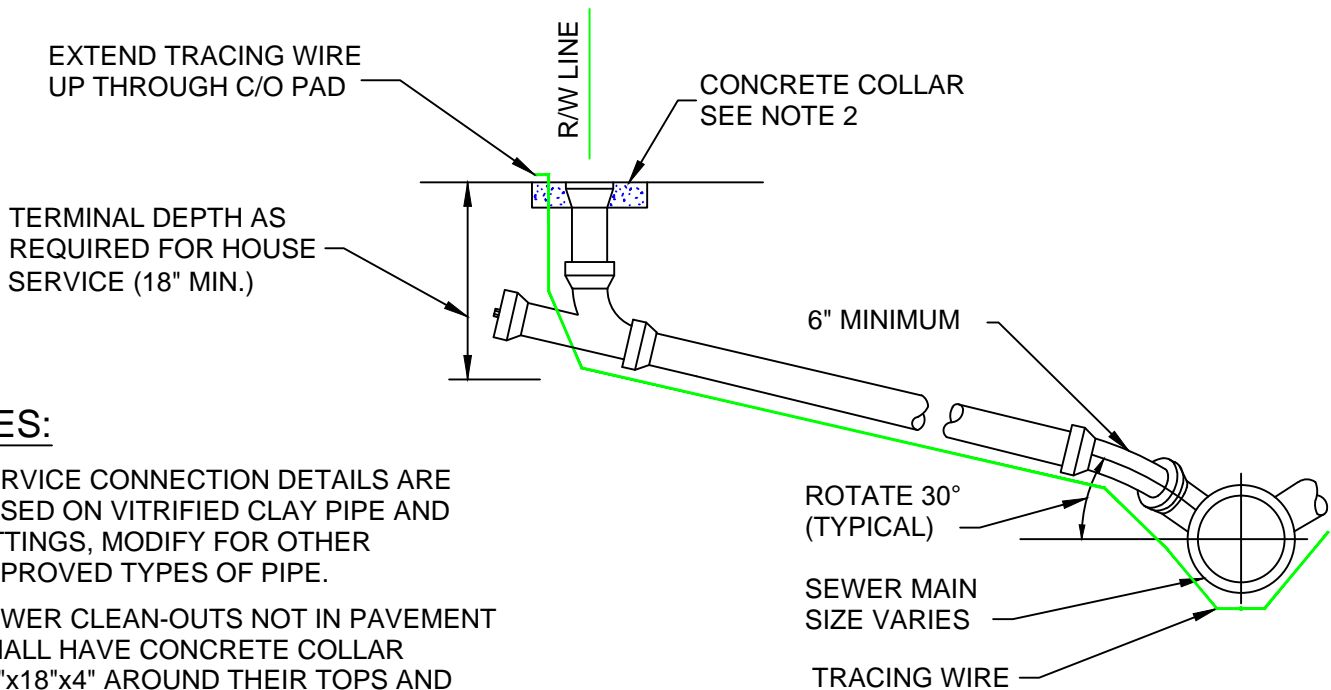

PROFILE

NOTES:

1. SERVICE CONNECTION DETAILS ARE BASED ON VITRIFIED CLAY PIPE AND FITTINGS, MODIFY FOR OTHER APPROVED TYPES OF PIPE.
2. SEWER CLEAN-OUTS NOT IN PAVEMENT SHALL HAVE CONCRETE COLLAR 18"x18"x4" AROUND THEIR TOPS AND MUST BE INSTALLED AND ADJUSTED TO FINISHED GRADE AT THE RIGHT-OF-WAY/PROPERTY LINE
3. ALL PVC TO CLAY SERVICE CONNECTIONS UNDER LOAD BEARING SURFACES SHALL USE DFW NON-SHEAR FERNCO TYPE CONNECTORS OR APPROVED EQUAL.



CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

TYPICAL SEWER CONNECTION

SS002-2

ISSUED 2017

REVISED 03/01/2017 BY DJB