



PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

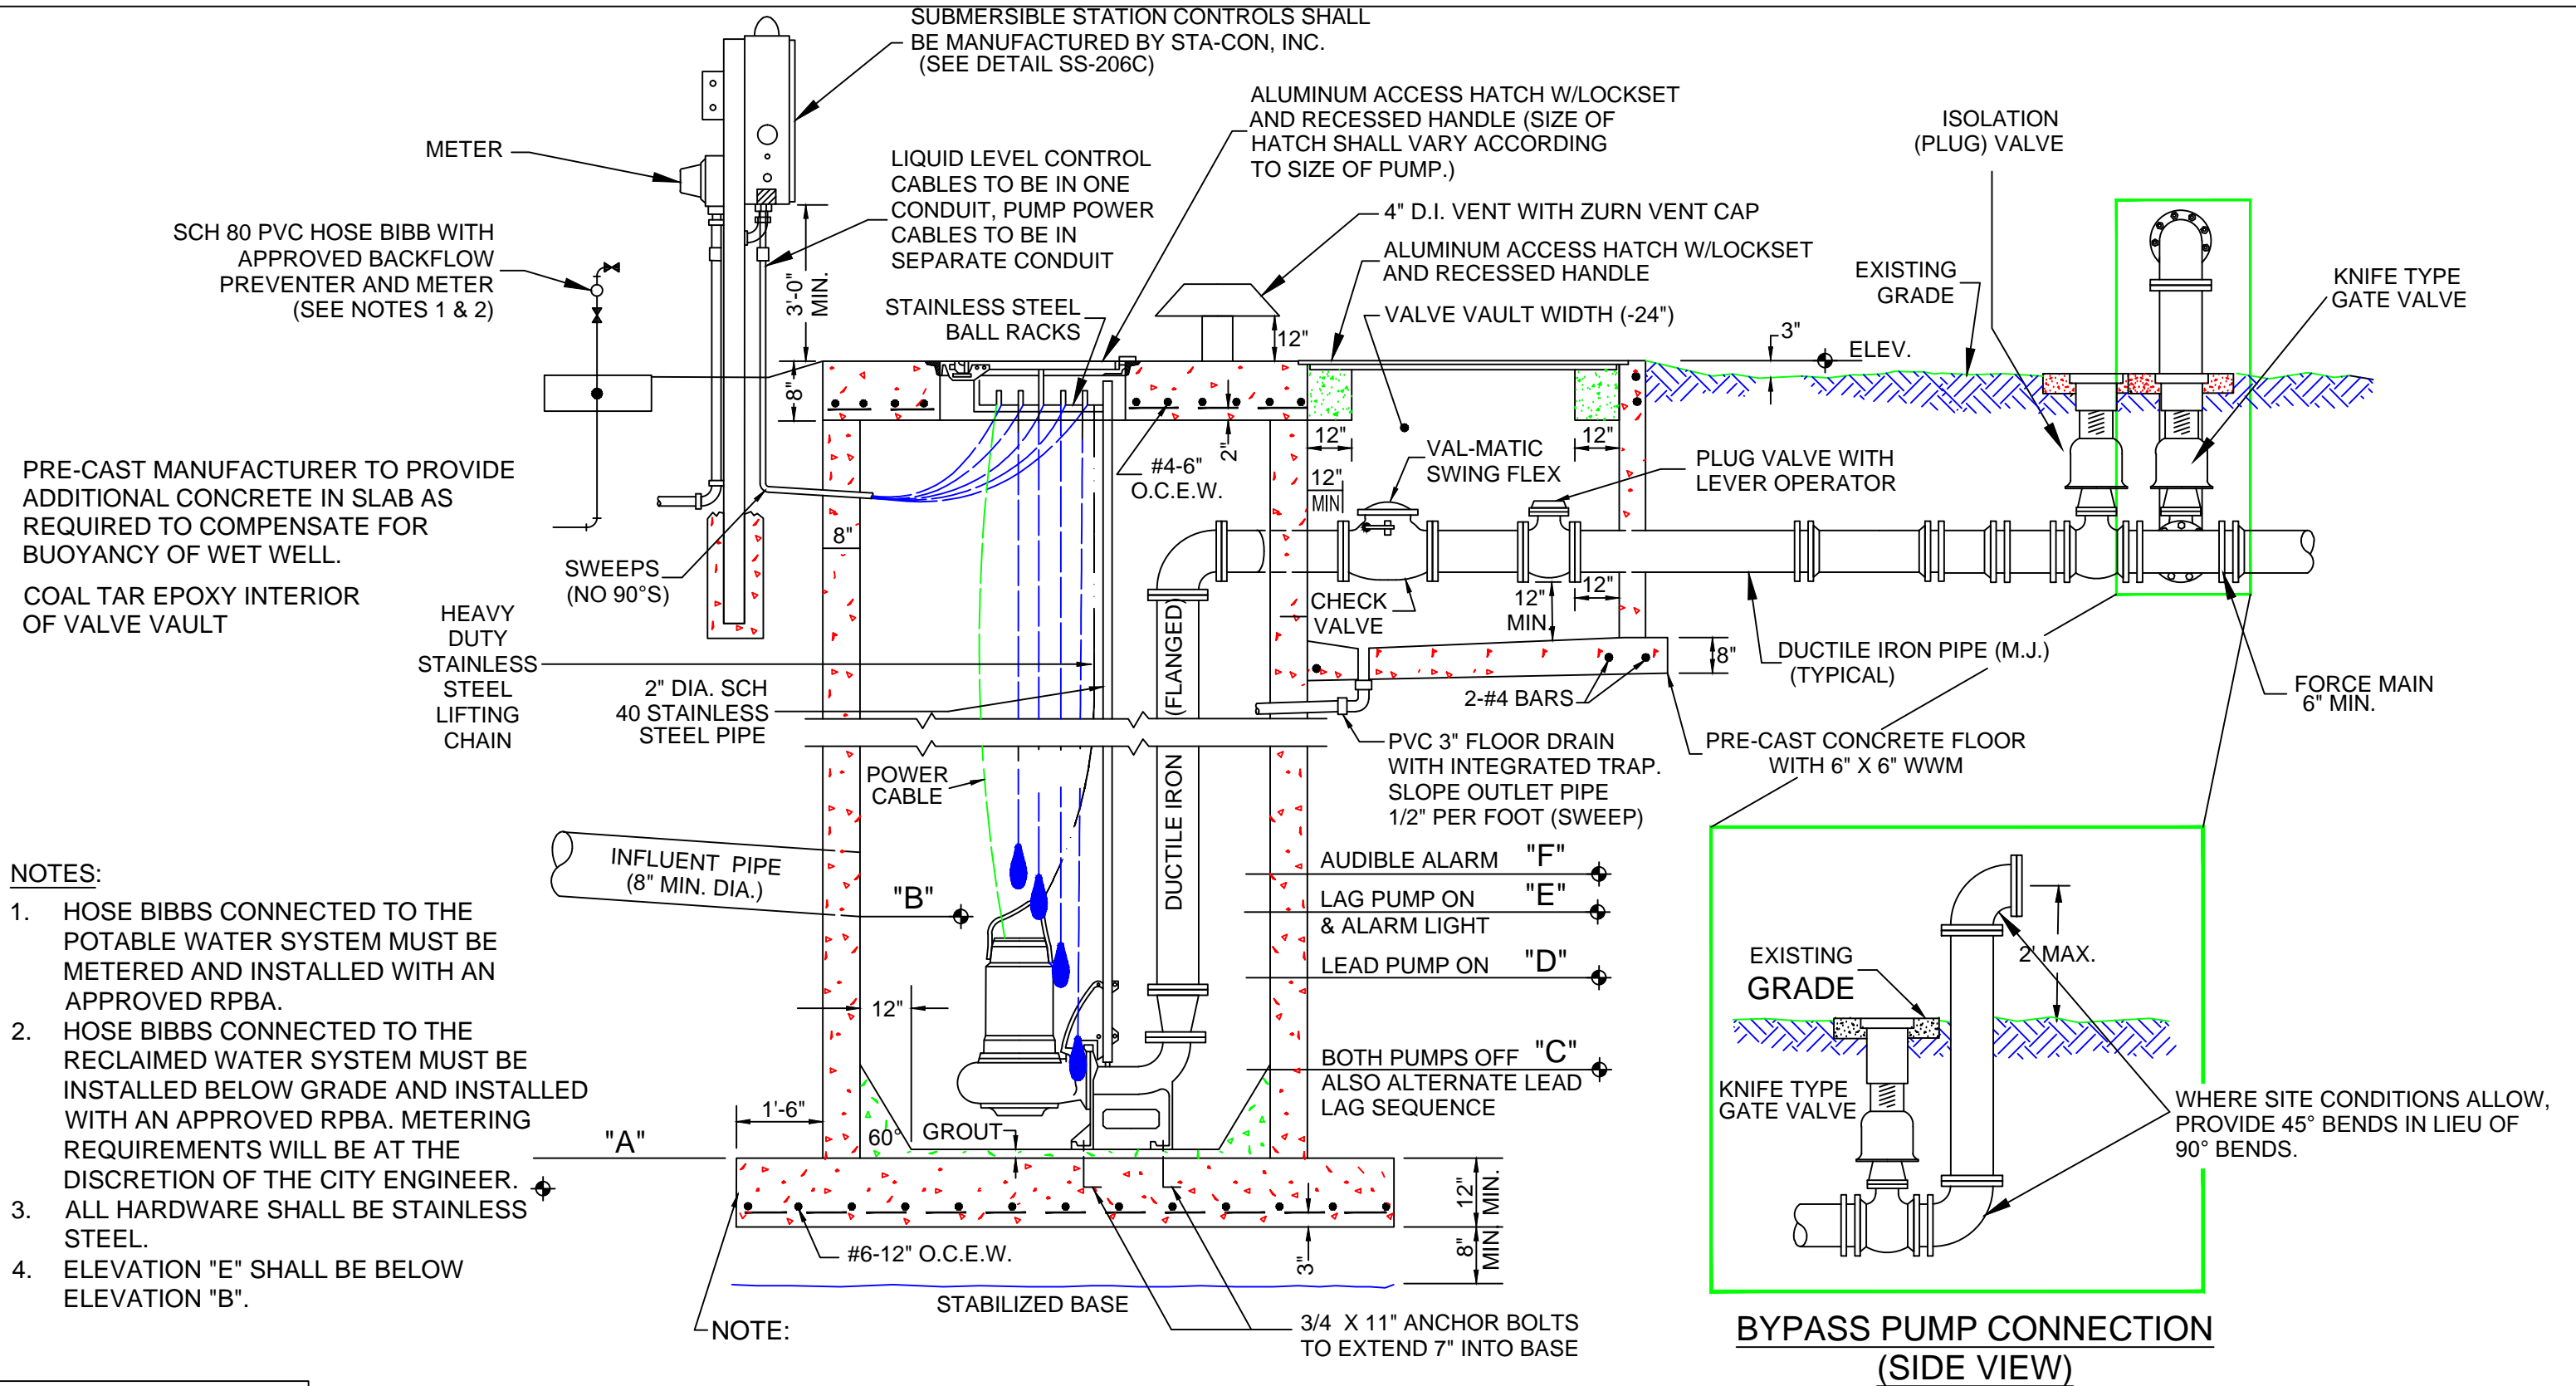

PRE-CAST MANUFACTURER TO PROVIDE ADDITIONAL CONCRETE IN SLAB AS REQUIRED TO COMPENSATE FOR BUOYANCY OF WET WELL.

COAL TAR EPOXY INTERIOR OF VALVE VAULT

- NOTES:**
1. HOSE BIBBS CONNECTED TO THE POTABLE WATER SYSTEM MUST BE METERED AND INSTALLED WITH AN APPROVED RPBA.
 2. HOSE BIBBS CONNECTED TO THE RECLAIMED WATER SYSTEM MUST BE INSTALLED BELOW GRADE AND INSTALLED WITH AN APPROVED RPBA. METERING REQUIREMENTS WILL BE AT THE DISCRETION OF THE CITY ENGINEER.
 3. ALL HARDWARE SHALL BE STAINLESS STEEL.
 4. ELEVATION "E" SHALL BE BELOW ELEVATION "B".

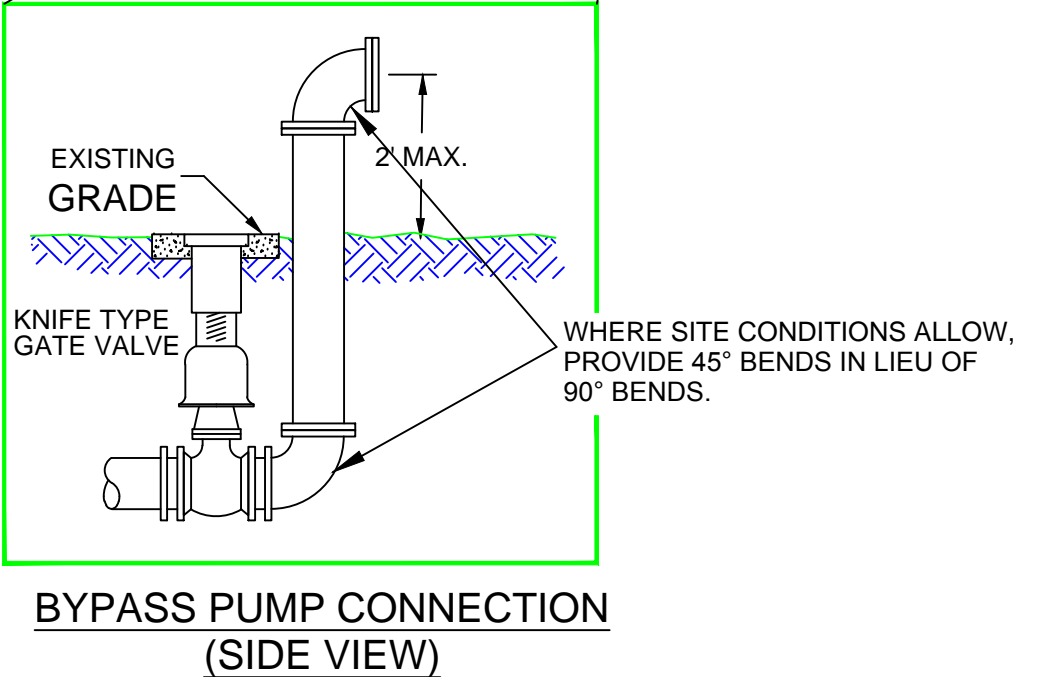

CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

LIFT STATION ELEVATION

SS007-1A

ISSUED 2017

REVISED 03/01/2017 BY DJB