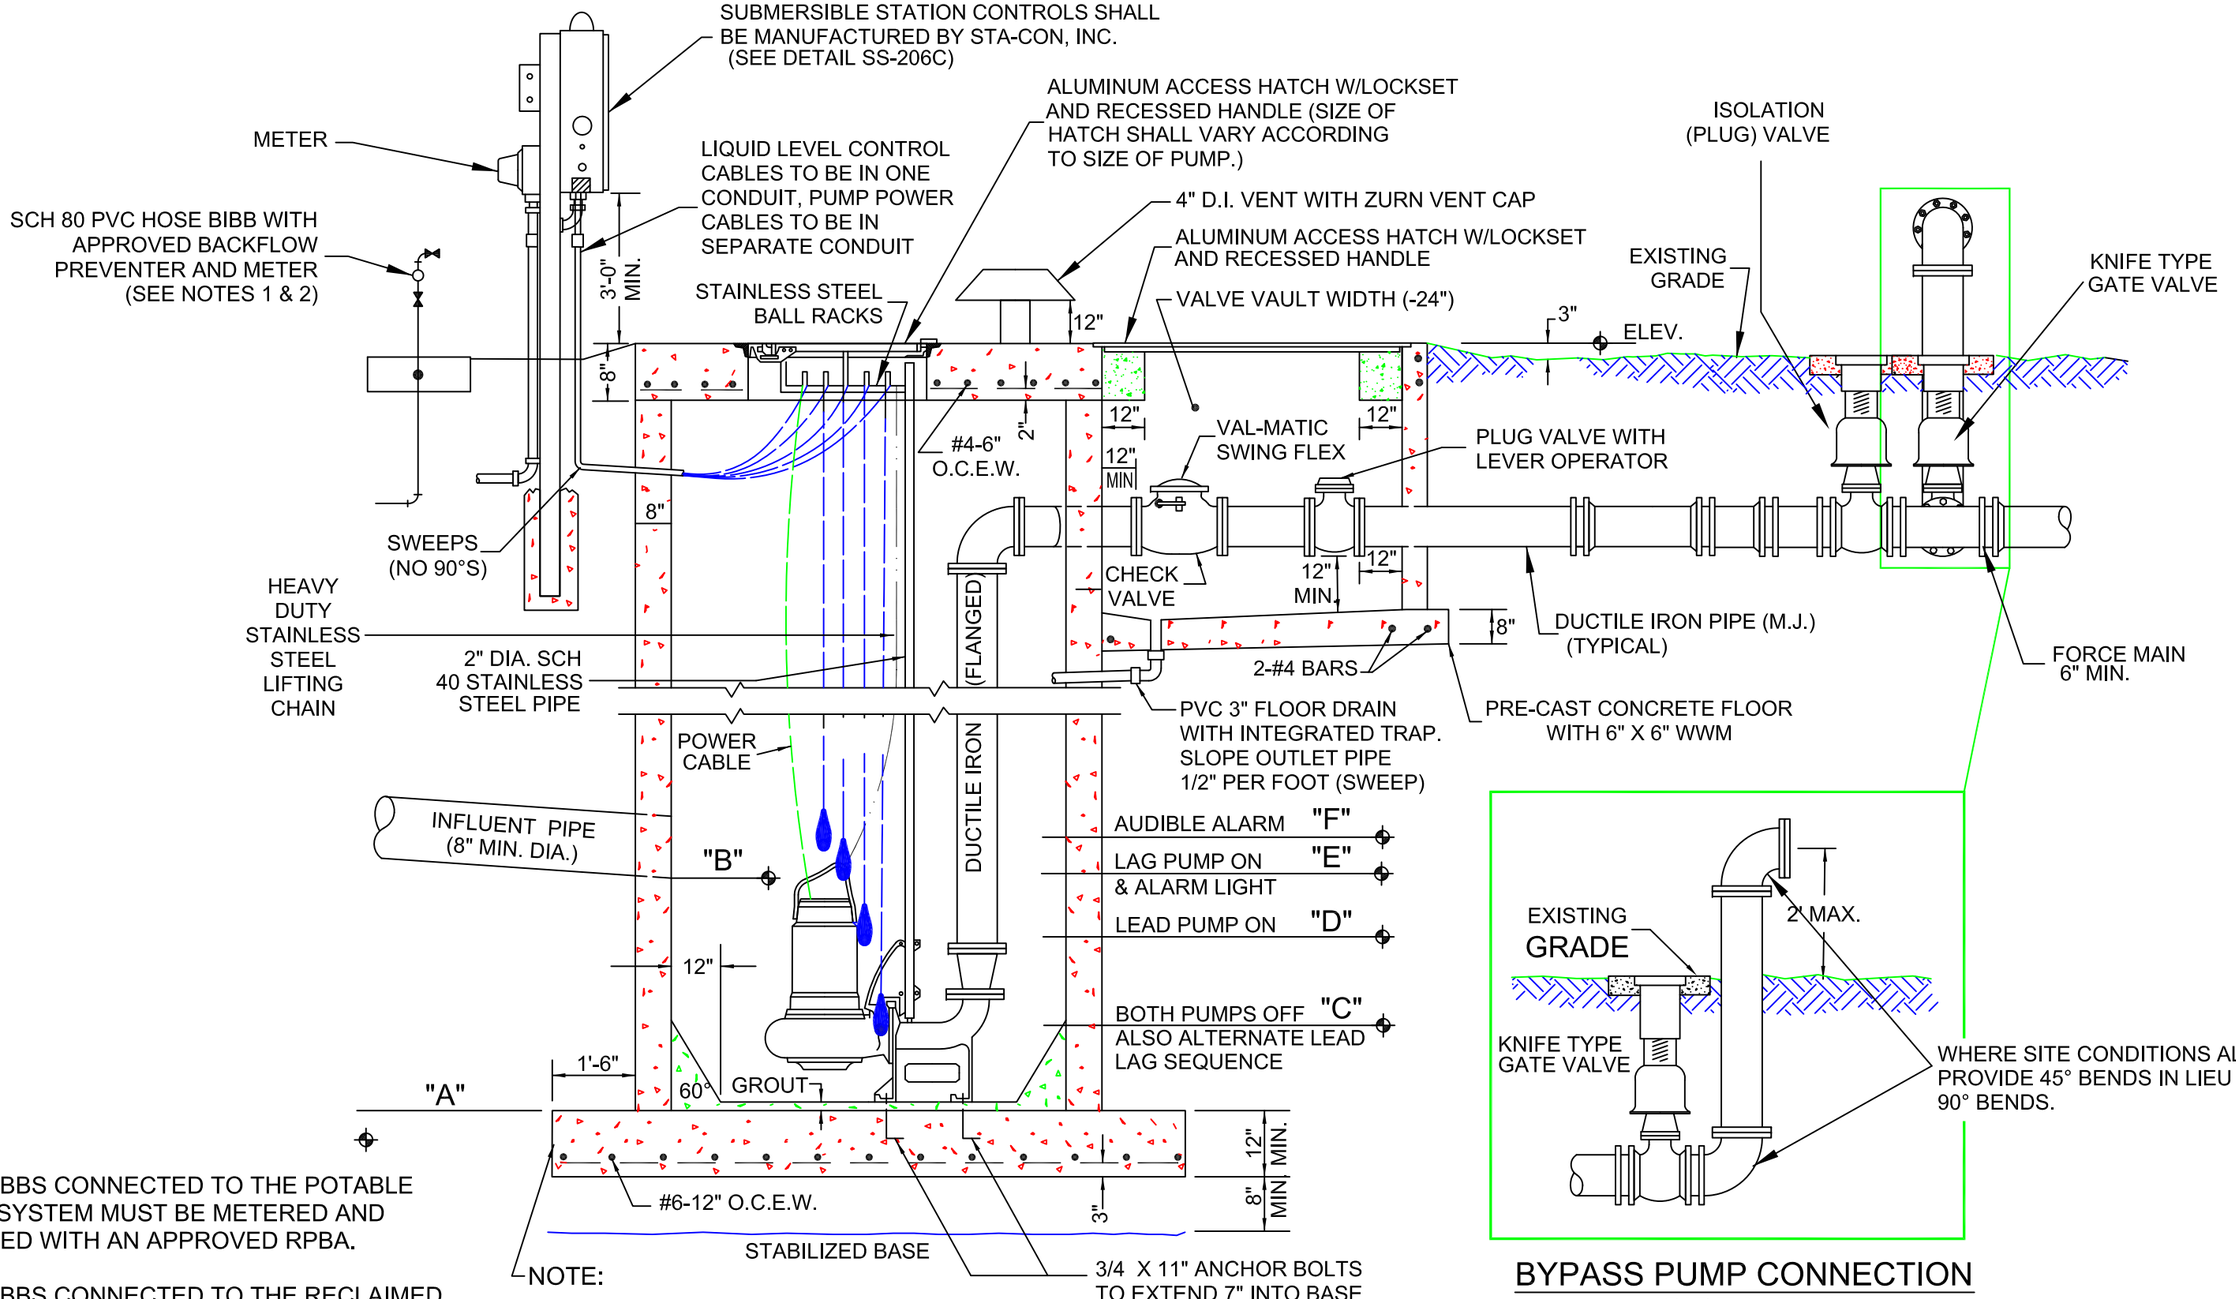

BYPASS PUMP CONNECTION (SIDE VIEW)

1. HOSE BIBBS CONNECTED TO THE POTABLE WATER SYSTEM MUST BE METERED AND INSTALLED WITH AN APPROVED RPBA.
2. HOSE BIBBS CONNECTED TO THE RECLAIMED WATER SYSTEM MUST BE INSTALLED BELOW GRADE AND INSTALLED WITH AN APPROVED RPBA. METERING REQUIREMENTS WILL BE AT THE DISCRETION OF THE CITY ENGINEER.
3. ALL HARDWARE SHALL BE STAINLESS STEEL.
4. ELEVATION "E" SHALL BE BELOW ELEVATION "B".

NOTE:

PRE-CAST MANUFACTURER TO PROVIDE ADDITIONAL CONCRETE IN SLAB AS REQUIRED TO COMPENSATE FOR BUOYANCY OF WET WELL.

COAL TAR EPOXY INTERIOR OF VALVE VAULT

STANDARD DETAILS	LIFT STATION ELEVATION	SS007-1A
CITY OF ALTAMONTE SPRINGS PUBLIC WORKS ADMIN. REVISED BY: GRL 10/26/12		ISSUE YEAR 2013