


# PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

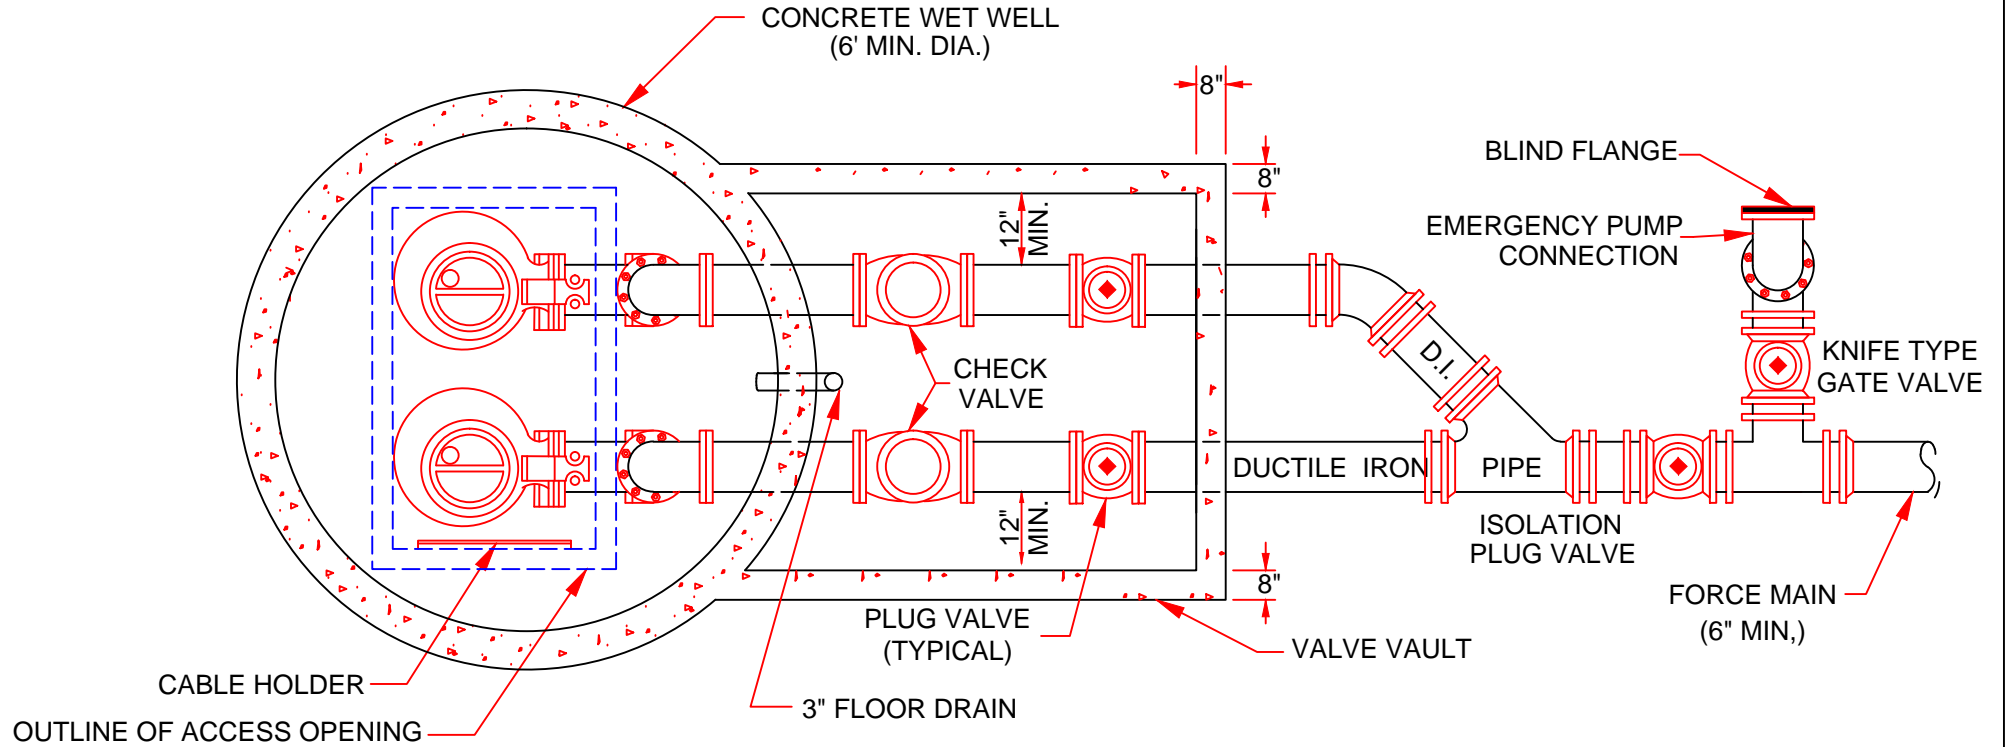

**PLAN VIEW**

## INDEX OF REQUIRED PUMP PULLING CABLES

PUMP SIZE	REQUIRED CHAIN SIZE
0.5 HP - 5.0 HP	1/4-INCH STAINLESS STEEL CHAIN
5.5 HP - 9.4 HP	5/16-INCH STAINLESS STEEL CHAIN
9.5 HP - 18.0 HP	3/8-INCH STAINLESS STEEL CHAIN
18.8 HP AND UP	SIZE ACCORDING TO WEIGHT OF PUMP (NOT LESS THAN 3/8-INCH STAINLESS STEEL CHAIN)



CITY OF ALTAMONTE SPRINGS  
950 CALABRIA DRIVE  
ALTAMONTE SPRINGS, FLORIDA 32714

## LIFT STATION PLAN VIEW

**SS007-1B**

ISSUED 2017

REVISED 03/01/2017 BY DJB