


PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS



NOTE:

ALL PIPE AND FITTINGS
MUST BE SCHEDULE 80 P.V.C.

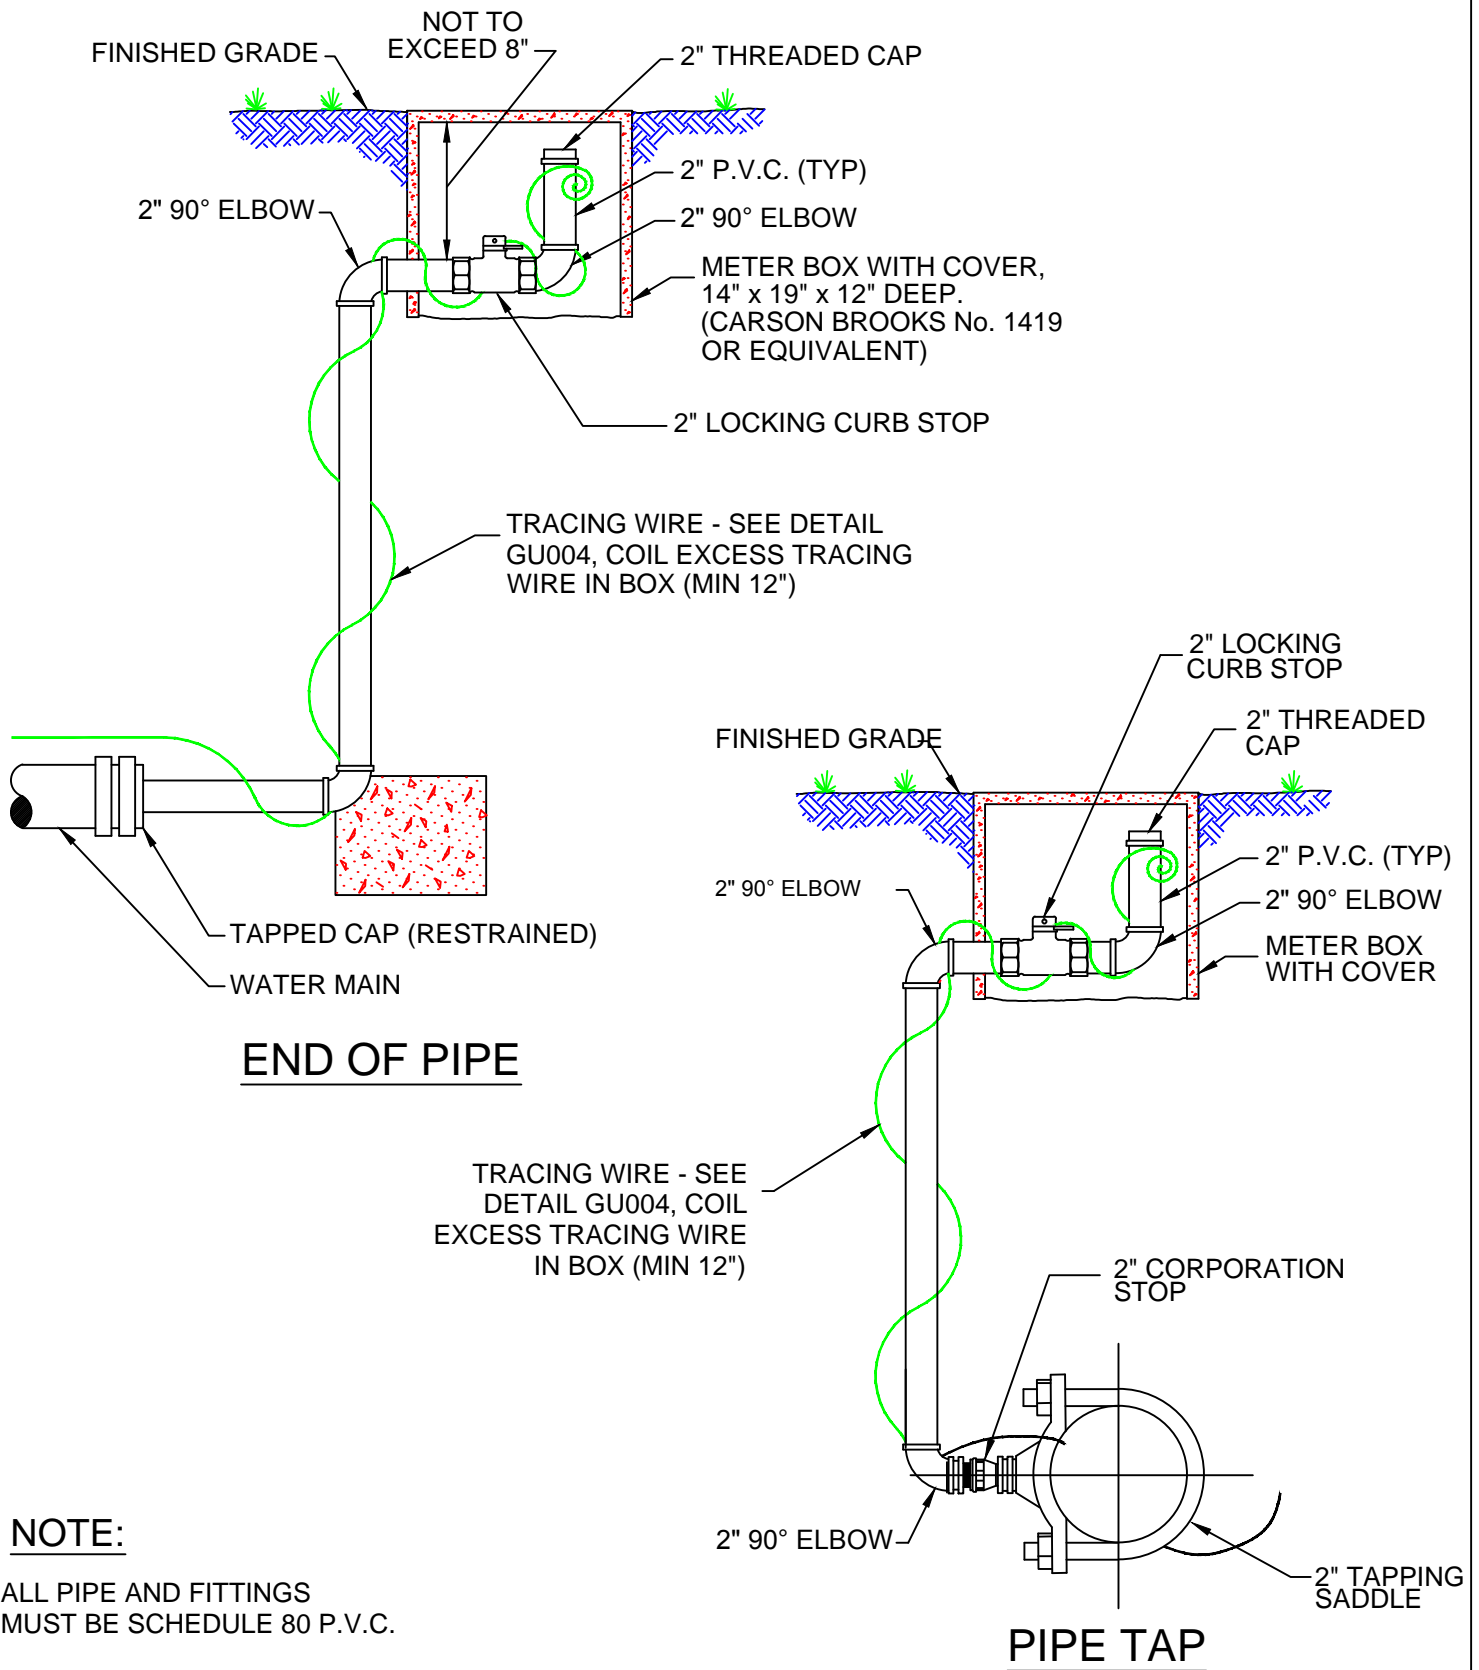

CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

LINE FLUSHING ASSEMBLIES

GU009-3

ISSUED 2017

REVISED 03/01/2017 BY DJB