


PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

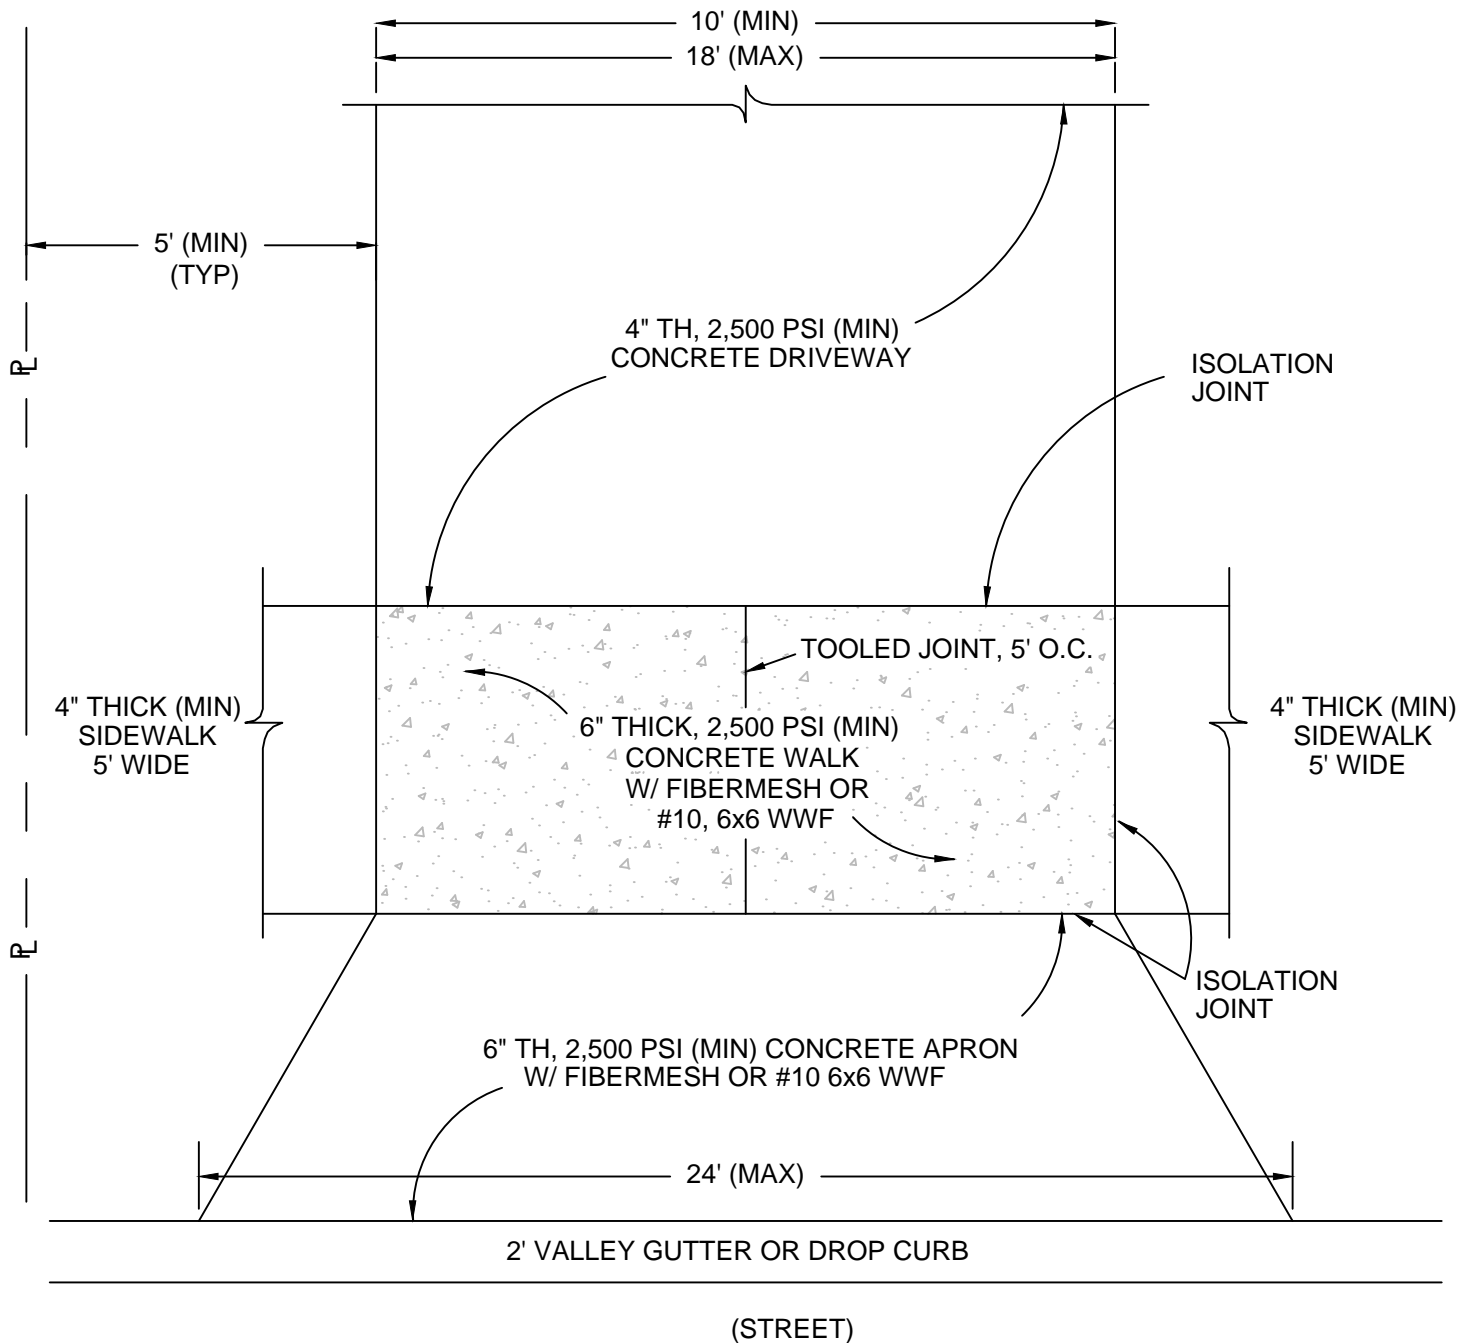

APRON FLARE WIDTH: MINIMUM 2' EACH SIDE.
 MAXIMUM 3' EACH SIDE,
 NOT TO EXCEED 24' TOTAL WIDTH.

NOTES:

1. MINIMUM CONCRETE STRENGTHS ARE BASED ON 28-DAY TESTS AS PER ASTM C1074-98.
2. REFER TO MI011-2 FOR SIDEWALK CONSTRUCTION REQUIREMENTS.
3. CONCRETE PAVEMENT JOINTS SHALL BE AS SPECIFIED IN FDOT DESIGN STANDARD INDEX NO. 305. WOOD IS PROHIBITED.
4. CENTER LINE SHALL BE MINIMUM 40' FROM CENTER LINE OF NEAREST EXISTING DRIVEWAY.
5. CENTERLINE OF DRIVEWAY SHALL BE 50' MINIMUM FROM RIGHT OF WAY LINE OF A INTERSECTION.



CITY OF ALTAMONTE SPRINGS
 950 CALABRIA DRIVE
 ALTAMONTE SPRINGS, FLORIDA 32714

RESIDENTIAL DRIVEWAY CONSTRUCTION

MI016-3

ISSUED 2017

REVISED 03/01/2017 BY DJB