



PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

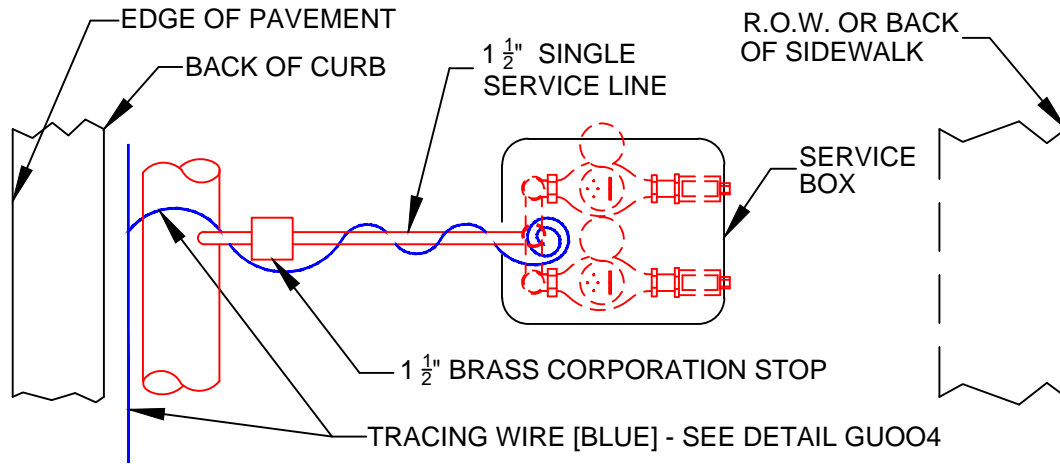

PLAN

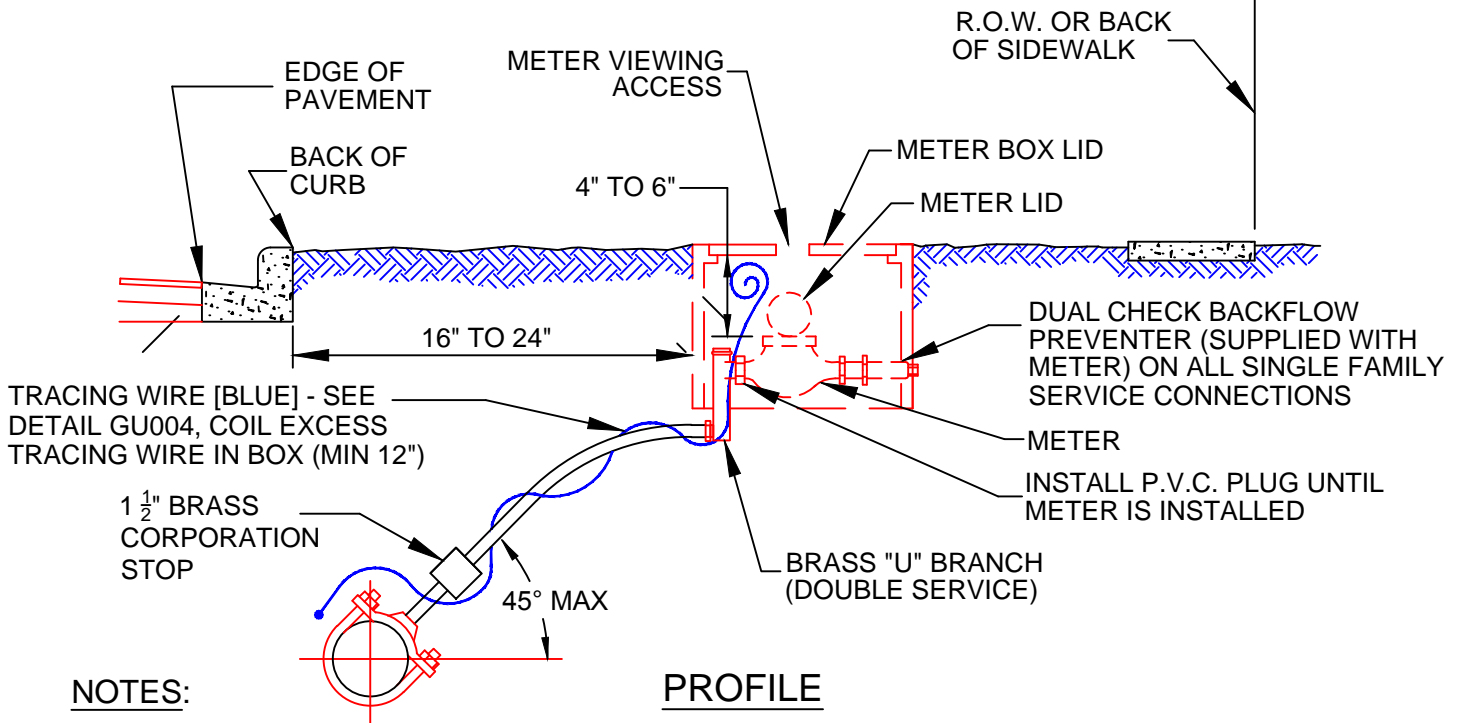

PROFILE

NOTES:

1. THE CITY INSTALLS THE METER AND DUAL CHECK VALVE(S) IN THE SERVICE BOX. CONTRACTOR SPECIFIES 3/4" OR 1" SIZING FOR THE METER AND DUAL CHECK VALVES.
2. METER SHALL BE INSTALLED BETWEEN SIDEWALK AND CURB AND IN NO CASE SHALL IT BE INSTALLED IN SIDEWALK OR OTHER PAVED AREAS.
3. A DUAL CHECK BACKFLOW PREVENTER WILL BE FURNISHED WITH METER BY CITY OF ALTAMONTE SPRINGS ON ALL SINGLE FAMILY SERVICE CONNECTIONS. BACKFLOW PREVENTERS WILL NOT BE SUPPLIED BY THE CITY OF ALTAMONTE SPRINGS ON COMMERCIAL SERVICE CONNECTIONS. BACKFLOW PREVENTER REQUIREMENTS WILL VARY FOR COMMERCIAL CONNECTIONS.
4. ALL POTABLE WATER SERVICE AND PROPERTIES WITH ALTERNATIVE WATER SYSTEMS (WELL, ETC.) REQUIRE AN ABOVE GROUND BACKFLOW PROTECTION DEVICE ON THE OUTLET SIDE OF THE METER.
5. SERVICE LINES SHALL NOT BE LESS THAN METER SIZE.



CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

POTABLE WATER - DOUBLE SERVICE CONNECTION (1-INCH OR LESS)

PW003-1D

ISSUED 2017

REVISED 03/01/2017 BY DJB