


PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS



NOTES:

1. THE CITY INSTALLS THE METER IN THE SERVICE BOX.
2. METER SHALL BE INSTALLED BETWEEN SIDEWALK AND CURB AND IN NO CASE SHALL IT BE INSTALLED IN SIDEWALK OR OTHER PAVED AREAS.
3. THE CONTRACTOR IS REQUIRED TO INSTALL AN ABOVE GROUND BACKFLOW PROTECTION DEVICE ON THE OUTLET SIDE OF THE METER. THE TYPE OF BACKFLOW PROTECTION DEVICE WILL VARY AND BE DETERMINED BY THE CROSS CONNECTION CONTROL SUPERVISOR BASED ON THE DEGREE OF HAZARD.
4. ALL POTABLE WATER SERVICE AND PROPERTIES WITH ALTERNATE WATER SYSTEMS (WELL, ETC.) REQUIRE AN ABOVE GROUND BACKFLOW PROTECTION DEVICE ON THE OUTLET SIDE OF THE METER.
5. SERVICE LINES SHALL NOT BE LESS THAN METER SIZE.

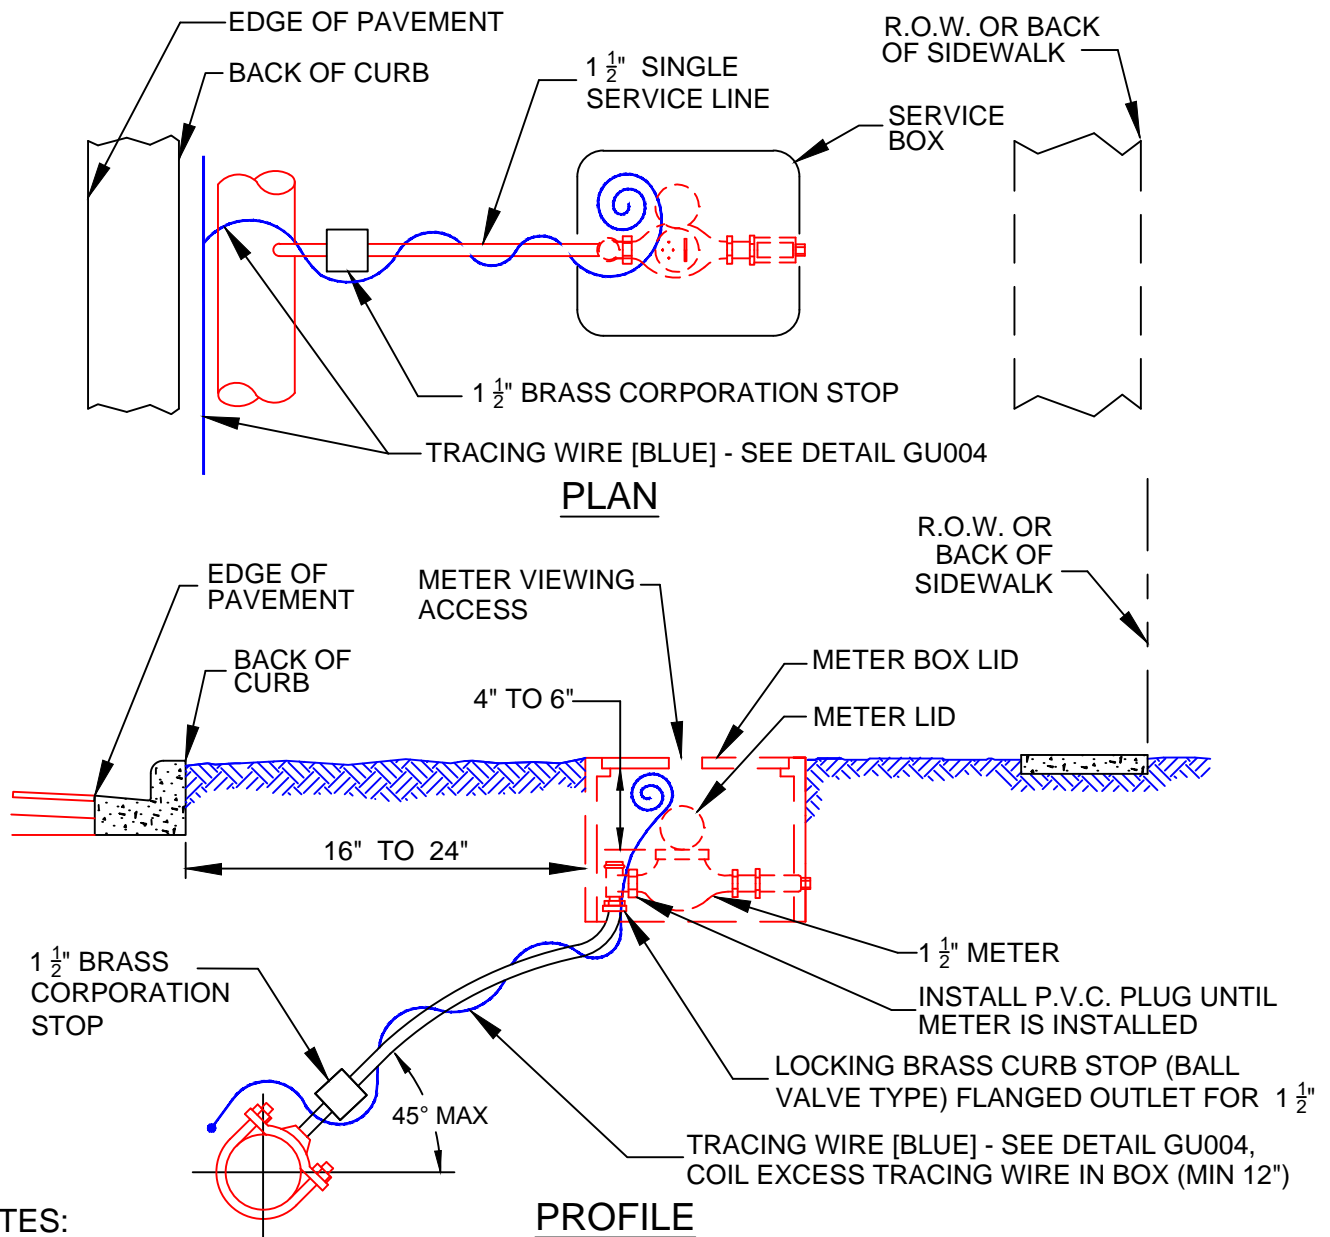

CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

POTABLE WATER - SINGLE SERVICE CONNECTION (1.5-INCH)

PW003-1B

ISSUED 2017

REVISED 03/01/2017 BY DJB