



# PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

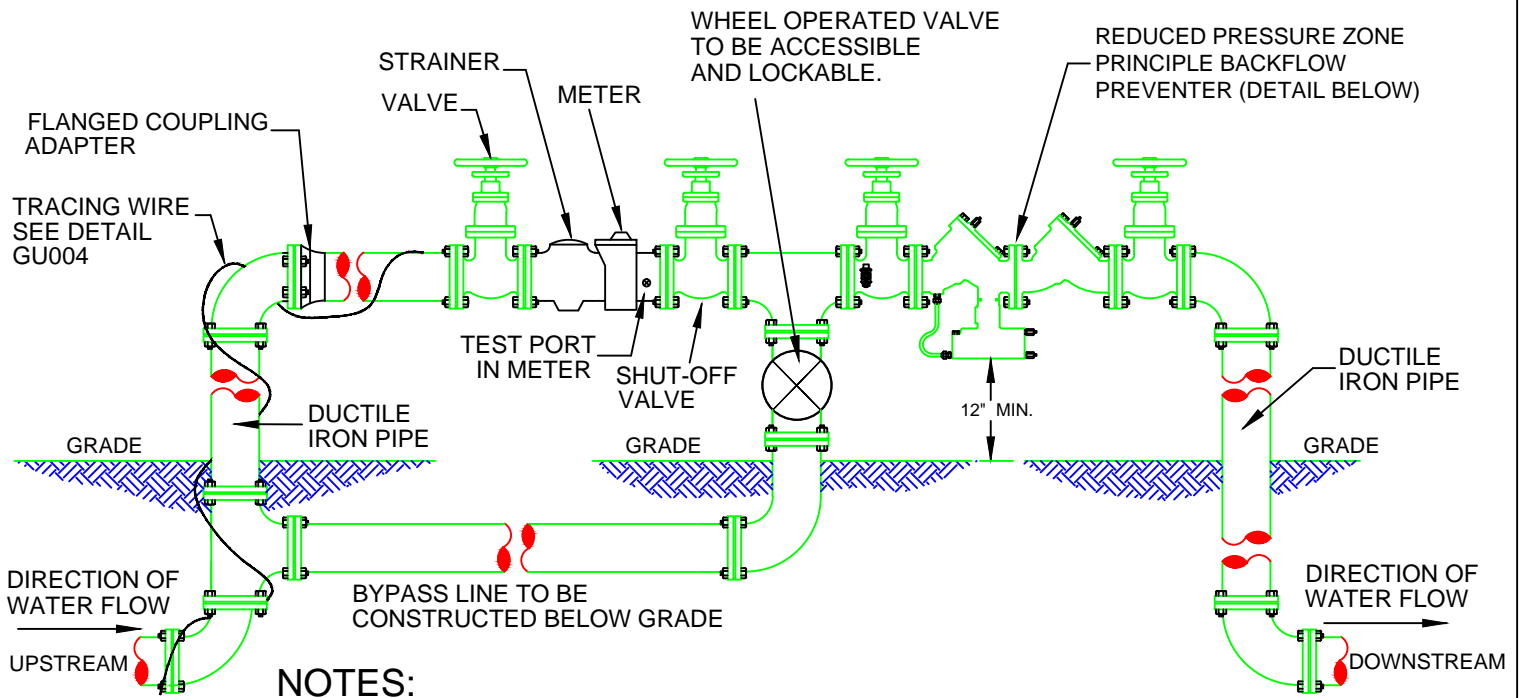

## NOTES:

1. ALL DOMESTIC METERS TO BE COMPOUND OR FIRE LINE.
2. IRRIGATION METERS TO BE APPROVED TURBINE METERS.
3. METERS UP TO AND INCLUDING 2" TO BE PURCHASED FROM THE CITY. LARGER THAN 2" TO BE APPROVED BY CITY ENGINEER & PURCHASED BY OWNER.
4. METERS TO BE INSTALLED ABOVE GROUND.

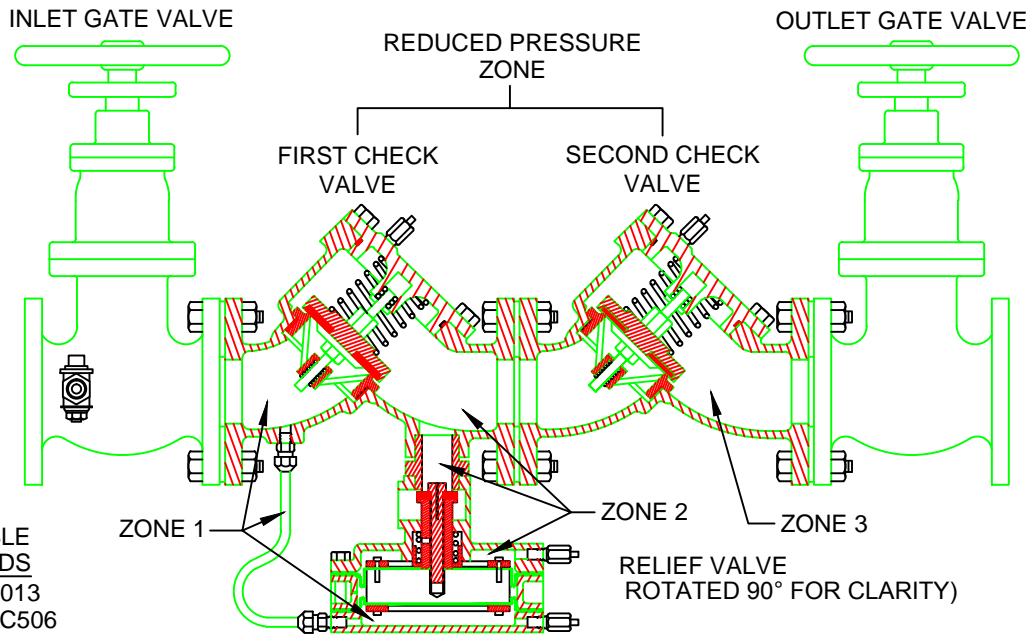

APPLICABLE STANDARDS  
 A.S.S.E. 1013  
 A.W.W.A. C506  
 FCCCHR of USC



CITY OF ALTAMONTE SPRINGS  
 950 CALABRIA DRIVE  
 ALTAMONTE SPRINGS, FLORIDA 32714

## MASTER METER ASSEMBLY WITH BY-PASS & REDUCED PRESSURE BACKFLOW PREVENTION ASSEMBLY

**PW007-4**

ISSUED 2017

REVISED 03/01/2017 BY DJB