


# PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS



## NOTES:

1. WATER METERS ARE TO BE LOCATED NO HIGHER THAN 5 FEET FROM THE FLOOR IN AN ACCESSIBLE AREA.
2. WATER METERS CAN BE INSTALLED IN A VERTICAL OR HORIZONTAL POSITION.
3. THE LOCATION OF THE WATER METER IS SUBJECT TO COMMENT BY THE CITY'S BUILDING AND FIRE SAFETY (B/FS) PLUMBING INSPECTOR.
4. ALL WATER METERS SHALL BE ISSUED BY, AND/OR PURCHASED FROM, THE CITY OF ALTAMONTE SPRINGS.
5. TO REUSE THE EXISTING CITY-ISSUED WATER METERS, CONTACT THE CITY OF ALTAMONTE SPRINGS UTILITY BILLING DEPARTMENT WITH THE SERIAL NUMBER, NAME OF BUSINESS AND SUITE NUMBER TO OBTAIN WRITTEN APPROVAL. WRITTEN APPROVAL SHALL BE REQUIRED TO BE PRESENTED TO THE PLUMBING INSPECTOR AT THE TIME OF INSPECTION. (NO OTHER WATER METERS WILL BE ACCEPTED.)
6. IF AN EXISTING WATER METER IS LOCATED OR REMOVED, THE WATER SERVICE MUST BE PERMANENTLY CAPPED OFF. ALL WATER METERS REMOVED FROM SERVICE MUST BE RETURNED TO THE CITY.
7. ALL WATER METERS SHALL HAVE A BRASS, LOCKABLE CURB STOP UPSTREAM OF THE METER.

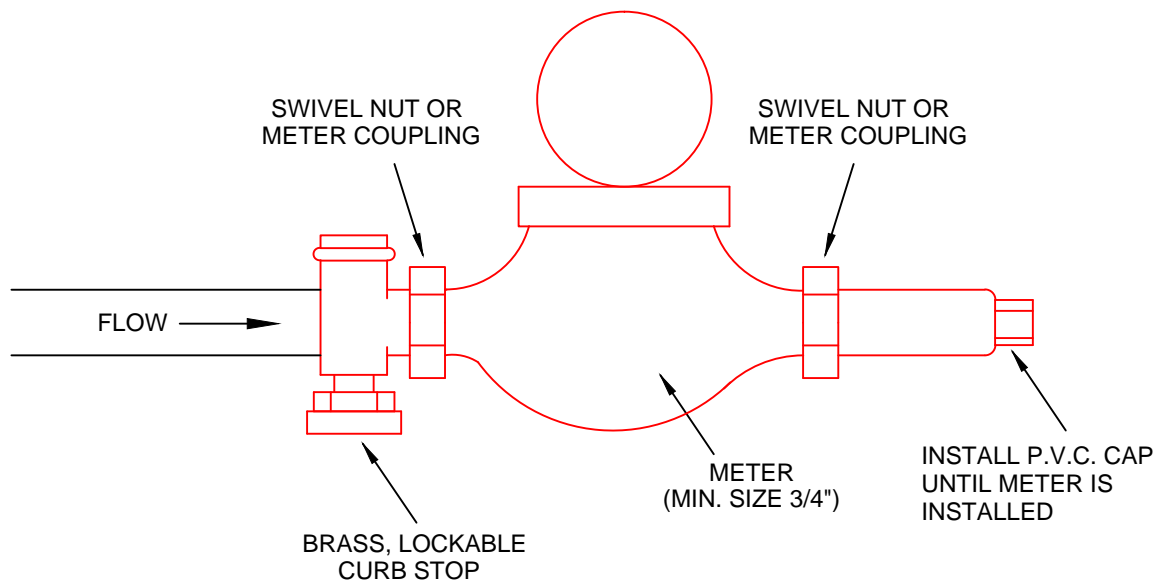

CITY OF ALTAMONTE SPRINGS  
950 CALABRIA DRIVE  
ALTAMONTE SPRINGS, FLORIDA 32714

## WATER METER LOCATION - REQUIREMENTS FOR INTERIOR, COMMERCIAL USE

PW011-0

ISSUED 2017

REVISED 03/01/2017 BY DJB