


PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

BONNET AND NOZZLE CAPS COLOR FINAL COAT:

TO BE APPLIED BY THE CITY
OF ALTAMONTE SPRINGS.

BARREL FINAL COAT:

1. TRAFFIC SAFETY YELLOW ON
PUBLIC WATER SYSTEM.
2. RED ON PRIVATE WATER
SYSTEMS.

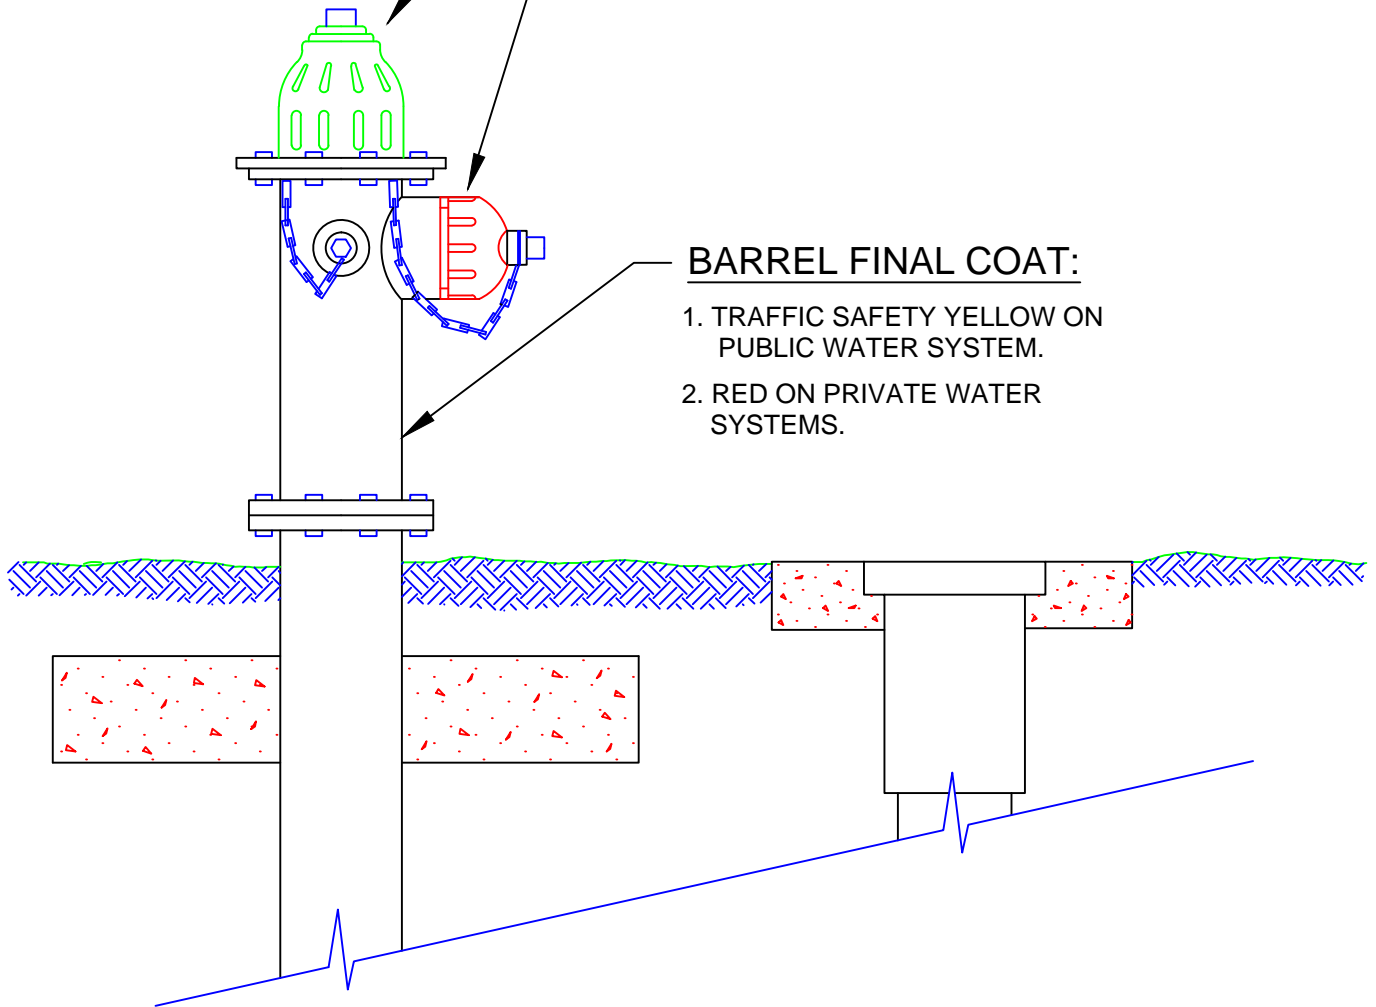

NOTE:

PAINT SHALL BE PORTER PAINTS (SAFETY) DTM
ACRYLIC GLOSS ENAMEL #2912 OR EQUAL.



CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

FIRE HYDRANT COLOR IDENTIFICATION

GU013-0

ISSUED 2017

REVISED 03/01/2017 BY DJB